



**RWE Renewables UK Dogger Bank
South (West) Limited**

**RWE Renewables UK Dogger Bank
South (East) Limited**

Dogger Bank South Offshore Wind Farms


**Preliminary Environmental Information Report
Chapter 05 – Project Description**

28/04/2023

Document Reference: 004300112

Revision: 05

Unrestricted

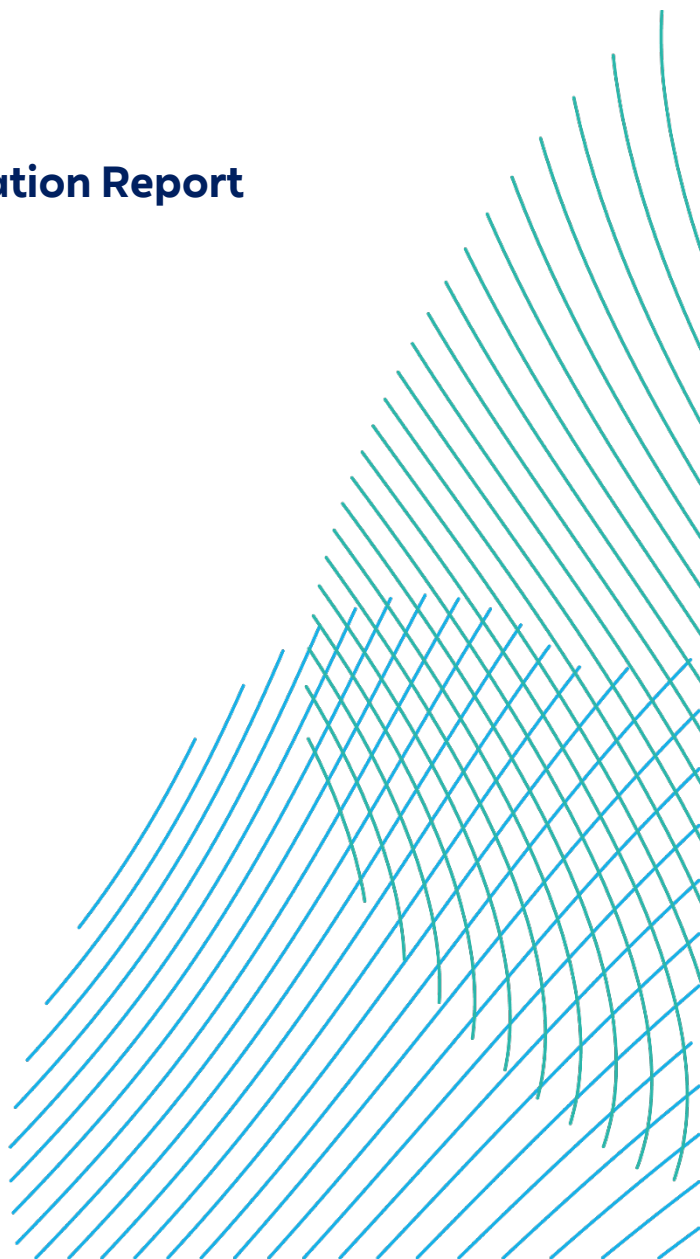



Company:	RWE Renewables UK Dogger Bank South (West) Limited and RWE Renewables UK Dogger Bank South (East) Limited	Asset:	Development
Project:	Dogger Bank South Offshore Wind Farms	Sub Project/Package:	Consents
Document Title or Description:	Preliminary Environmental Information Report – Chapter 5 – Project Description		
Document Number:	004300112-05	Contractor Reference Number:	PC2340-RHD-ON-ZZ- AX-Z-0027

The document Originator shall complete this Cover Sheet and may give guidance below on any actions required by the recipient(s). The document Checker and Approver must not be the same person. The Document Author and Approver must not be the same person. The Approver must not be less senior than the Author.

COPYRIGHT © RWE Renewables UK Dogger Bank South (West) Limited and RWE Renewables UK Dogger Bank South (East) Limited.

All pre-existing rights reserved.

This document is supplied on and subject to the terms and conditions of the Contractual Agreement relating to this work, under which this document has been supplied, in particular:

LIABILITY

In preparation of this document RWE Renewables UK Dogger Bank South (West) Limited and RWE Renewables UK Dogger Bank South (East) Limited has made reasonable efforts to ensure that the content is accurate, up to date and complete for the purpose for which it was contracted. RWE Renewables UK Dogger Bank South (West) Limited and RWE Renewables UK Dogger Bank South (East) Limited makes no warranty as to the accuracy or completeness of material supplied by the client or their agent.

Other than any liability on RWE Renewables UK Dogger Bank South (West) Limited and RWE Renewables UK Dogger Bank South (East) Limited detailed in the contracts between the parties for this work RWE Renewables UK Dogger Bank South (West) Limited and RWE Renewables UK Dogger Bank South (East) Limited shall have no liability for any loss, damage, injury, claim, expense, cost or other consequence arising as a result of use or reliance upon any information contained in or omitted from this document.

Any persons intending to use this document should satisfy themselves as to its applicability for their intended purpose.

The user of this document has the obligation to employ safe working practices for any activities referred to and to adopt specific practices appropriate to local conditions.

Rev No.	Date	Status/Reason for Issue	Author	Checked by	Approved by
01	27/01/2023	First Issue	AS/CC	RH	HC
02	06/03/2023	Second Issue	AS/CC	RH	HC
03	28/03/2023	Third Issue	AS/CC	RH	HC
04	25/04/2023	Fourth Issue	CC/JF	RH	HC
05	28/04/2023	Fifth Issue	CC/JF	HC	CM

Unrestricted

ID	Obstacle Type
RX	Road Crossing
PRX	Private Road Crossing
UTX	Under Track Crossing
UUX	Underground Utilities Crossing
OUX	Overhead Utilities Crossing
WX	Watercourse Crossing
EOX	Environmental Obstacle Crossing
PAT	Footpath, bridleway or other track crossing
OOX	Other Obstacle Crossing

Proposed Crossing Methodology (Columns I to L)	Description
Y	Yes (currently assumed crossing technique)
P	Possible Alternative, to be included within consent envelope
N	Not Being Considered
N/A	Not Applicable

Proposed Haul Road Crossing (Column Q)	Description
Y	Yes - current assumption is haul road continuity across constraint (or access from Public Highway)
P	Possibility for haul road continuity across
N	Haul road crossing of constraint (or access from Public Highway) not being considered.

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

DATE LAST UPDATE MADE	SECTION OF CABLE ROUTE	OBSTACLE TYPE	OBSTACLE ID	EASTING	NORTHING	OBSTACLE DETAILS	OVERHEAD / BURIED / SURFACE	TRENCHING	TRENCHLESS-HDD	TRENCHLESS-S- OTHER	POTENTIAL DIVERSION	STAKEHOLDER FEEDBACK	COMMENTS	CROSSING ID NUMBER	CONSIDERED CROSSING COMPLEXITY (1 = LOW, 2 = MODERATE, 3 = HIGH)	CONSIDERATION FOR HAUL ROAD CROSSING OF OBSTACLE REQUIRED	INDICATE WATERCOURSE HAUL ROAD CROSSING METHODOLOGY	HAUL ROAD CROSSING REQUIREMENTS	LOCATION ID NUMBER (FOR ORDERING OF CONSTRAINTS ONLY)
30/01/2023	SECTION 1	WX	S1-WX-01	517765.279	455396.511	WATERCOURSE / DRAIN	SURFACE	P	P	P	P	NONE TO DATE	POTENTIALLY CROSSED WITHIN LANDFALL HDD OR REQUIRE DIVERSION OF DRAIN FOR LANDFALL CONSTRUCTION AND TJB	ID-00001	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00001
30/01/2023	SECTION 1	WX	S1-WX-02	517613.031	455252.9883	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00002	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00002
30/01/2023	SECTION 1	EOX	S1-EOX-01	518024.826	454064.6504	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	CROSSED WITH S1-WX-03. ENT FOR CROSSING DEPENDANT ON LANDFALL HDD COMPOUND LOCATION, IF CROSSING REQUIRED THEN TRENCHING MOST LIKELY	ID-00003	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW POTENTIALLY REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00003
30/01/2023	SECTION 1	WX	S1-WX-03	518024.3	454065.71	WATERCOURSE / DRAIN	SURFACE	P	P	P	P	NONE TO DATE	REQUIREMENT FOR CROSSING DEPENDANT ON LANDFALL HDD COMPOUND LOCATION, IF CROSSING REQUIRED THEN TRENCHING MOST LIKELY	ID-00003	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00004
30/01/2023	SECTION 1	EOX	S1-EOX-02	518141.17	454161.3939	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	REQUIREMENT FOR CROSSING DEPENDANT ON LANDFALL HDD COMPOUND LOCATION, IF CROSSING REQUIRED THEN TRENCHING MOST LIKELY	ID-00004	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW POTENTIALLY REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00005
30/01/2023	SECTION 1	EOX	S1-EOX-03	518188.332	454254.2443	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	CROSSED WITH S1-WX-04. HEDGEROW POTENTIALLY LOCATED WITHIN LANDFALL HDD COMPOUND AND MAY NEED REMOVAL FOR LANDFALL AND TJB WORKS	ID-00005	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW POTENTIALLY REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00006
30/01/2023	SECTION 1	WX	S1-WX-04	518188.006	454255.712	WATERCOURSE / DRAIN	SURFACE	P	P	P	P	NONE TO DATE	DRAIN POTENTIALLY LOCATED WITHIN LANDFALL HDD COMPOUND FOOTPRINT AND MAY REQUIRE DIVERSION	ID-00005	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00007
30/01/2023	SECTION 1	EOX	S1-EOX-04	517972.855	454202.7503	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	CROSSED WITH S1-WX-05. REQUIREMENT FOR CROSSING DEPENDANT ON LANDFALL COMPOUND LOCATION	ID-00006	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW POTENTIALLY REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00008
30/01/2023	SECTION 1	WX	S1-WX-05	517973.116	454201.5523	WATERCOURSE / DRAIN	SURFACE	P	P	P	P	NONE TO DATE	REQUIREMENT FOR CROSSING DEPENDANT ON LANDFALL COMPOUND LOCATION	ID-00006	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00009
30/01/2023	SECTION 1	EOX	S1-EOX-05	518155.967	454332.746	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	HEDGEROW POTENTIALLY WITHIN LANDFALL HDD COMPOUND FOOTPRINT AND MAY NEED TO BE REMOVED FOR LANDFALL HDD AND TJB	ID-00007	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW POTENTIALLY REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00010
30/01/2023	SECTION 1	EOX	S1-EOX-06	517967.99	454349.64	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	HEDGEROW PARALLEL ALONG CABLE CORRIDOR, CABLE CROSSING OF HEDGEROW MAY BE ABLE TO BE AVOIDED	ID-00008	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW POTENTIALLY REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00011
30/01/2023	SECTION 1	EOX	S1-EOX-07	517825.34	454346.45	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00009	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW POTENTIALLY REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00012
30/01/2023	SECTION 1	EOX	S1-EOX-08	517722.979	454286.4581	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	HEDGEROW PARALLEL ALONG CABLE CORRIDOR, CABLE CROSSING OF HEDGEROW MAY BE ABLE TO BE AVOIDED	ID-00010	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW POTENTIALLY REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00013
30/01/2023	SECTION 1	EOX	S1-EOX-09	517525.605	455115.1444	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S1-RX-03	ID-00011	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00014
30/01/2023	SECTION 1	UUX	S1-UUX-02	517525.339	455113.7319	PROPOSED - BT OPENREACH UNDERGROUND TELECOM UTILITY	BURIED	P	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-03	ID-00011	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00015
30/01/2023	SECTION 1	UUX	S1-UUX-03	517524.924	455112.0288	BT OPENREACH UNDERGROUND TELECOM UTILITY	BURIED	P	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-03	ID-00011	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00016
30/01/2023	SECTION 1	UUX	S1-UUX-04	517524.579	455110.6112	YORKSHIRE WATER- WATER MAIN	BURIED	P	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-03	ID-00011	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00017
30/01/2023	SECTION 1	RX	S1-RX-03	517523.829	455107.4035	HORNSEA ROAD	SURFACE	P	Y	P	N	NONE TO DATE	ROAD CROSSING ALL OPTIONS AVAILABLE, TRENCHLESS MAY BE REQUIRED. POTENTIAL FOR EXTENSION OF HDD TO INCLUDE CROSSING OF S1-RX-01. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE.	ID-00011	2	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00018
30/01/2023	SECTION 1	EOX	S1-EOX-10	517521.839	455099.3671	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S1-RX-03	ID-00011	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00019
30/01/2023	SECTION 1	OUX	S1-OUX-01	517521.68	455098.7102	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	P	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-03	ID-00011	2	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00020
30/01/2023	SECTION 1	WX	S1-WX-06	517522.279	455101.1691	WATERCOURSE TO THE SOUTH OF HORNSEA RD	SURFACE	P	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-03	ID-00011	2	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00021
30/01/2023	SECTION 1	UUX	S1-UUX-17	517576.277	455095.6773	OPENREACH TELECOMS LINE (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00022
30/01/2023	SECTION 1	UUX	S1-UUX-05	517466.787	454873.3423	BT OPENREACH UNDERGROUND TELECOM UTILITY DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-01	ID-00012	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00023
30/01/2023	SECTION 1	EOX	S1-EOX-11	517467.361	454875.6996	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S1-RX-01	ID-00012	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00024
30/01/2023	SECTION 1	RX	S1-RX-01	517463.609	454860.1794	B1242 HORNSEA ROAD	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00012	2	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00025
30/01/2023	SECTION 1	UUX	S1-UUX-06	517462.228	454854.6239	YORKSHIRE WATER- WATER MAIN	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-01	ID-00012	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00026
30/01/2023	SECTION 1	UUX	S1-UUX-07	517461.974	454853.5824	NORTHERN POWERGRID LINE - LEFT IN SITU	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-01	ID-00012	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00027
30/01/2023	SECTION 1	EOX	S1-EOX-12	517460.009	454845.5121	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S1-RX-01	ID-00012	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00028
30/01/2023	SECTION1	OUX	S1-OUX-02	517460.733	454848.4877	NORTHERN POWERGRID HIGH VOLTAGE 11kV LINE	OVERHEAD	N	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-01	ID-00012	2	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00029
30/01/2023	SECTION 1	PAT	S1-PAT-01	516996.821	454306.693	PROW FOOTPATH	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00013	1	Y	N/A		ID-00030
30/01/2023	SECTION 1	WX	S1-WX-07	516838.648	454203.9675	STREAM DIKE	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00014	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00031
30/01/2023	SECTION 1	EOX	S1-EOX-13	516837.354	454202.9719	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S1-WX-07	ID-00014	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00032
30/01/2023	SECTION 1	UUX	S1-UUX-08	517635.783	454274.9487	BT OPENREACH UNDERGROUND TELECOM UTILITY	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-02	ID-00015	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00033
30/01/2023	SECTION 1	EOX	S1-EOX-14	517635.934	454274.9916	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S1-RX-02	ID-00015	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00034
30/01/2023	SECTION 1	WX	S1-WX-08	517634.586	454274.6088	WATERCOURSE / DRAIN	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-02	ID-00015	2	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00035
30/01/2023	SECTION 1	RX	S1-RX-02	517628.732	454273.0614	B1242 HORNSEA ROAD	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00015	2	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00036
30/01/2023	SECTION 1	UUX	S1-UUX-09	517625.149	454271.9295	YORKSHIRE WATER- WATER MAIN	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-02	ID-00015	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM. PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00037

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 1	UUX	S1-UUX-10	517624.526	454271.7525	NORTHERN POWERGRID LINE - LEFT IN SITU	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-02	ID-00015	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00038
30/01/2023	SECTION 1	EOX	S1-EOX-15	517621.848	454270.9921	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S1-RX-02	ID-00015	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00039
30/01/2023	SECTION 1	OUX	S1-OUX-03	517622.582	454271.2005	NORTHERN POWERGRID 11kV OVERHEAD POWER LINE	OVERHEAD	N	Y	P	P	NONE TO DATE	CROSSED WITH S1-RX-02	ID-00015	2	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00040
30/01/2023	SECTION 1	PAT	S1-PAT-02	517550.832	454295.9523	PROW FOOTPATH	SURFACE	P	P	P	P	NONE TO DATE	PUBLIC RIGHT OF WAY (FOOTPATH) LOCATED ALONG NORTHERN BOUNDARY OF CABLE CORRIDOR, REQUIREMENT FOR INTERACTION MAY BE ABLE TO BE AVOIDED	ID-00016	1	Y	N/A		ID-00041
30/01/2023	SECTION 1	WX	S1-WX-15	517549.219	454297.9891	WATERCOURSE (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00042
30/01/2023	SECTION 1	EOX	S1-EOX-28	517548.233	454299.3843	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00043
30/01/2023	SECTION 1	PAT	S1-PAT-03	517099.86	454066.9967	PROW FOOTPATH	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00017	1	Y	N/A		ID-00044
30/01/2023	SECTION 1	WX	S1-WX-09	516956.295	454011.7839	STREAM DIKE	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00018	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00045
30/01/2023	SECTION 1	EOX	S1-EOX-16	516954.787	454010.9324	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S1-WX-09	ID-00018	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00046
30/01/2023	SECTION 1	UUX	S1-UUX-11	516590.543	453956.0851	BT OPENREACH TELECOM UTILITY	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S1-RX-04	ID-00019	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00047
30/01/2023	SECTION 1	UUX	S1-UUX-12	516590.338	453955.7071	BT OPENREACH TELECOM DUCT	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S1-RX-04	ID-00019	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00048
30/01/2023	SECTION 1	EOX	S1-EOX-17	516591.337	453957.0769	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S1-RX-04	ID-00019	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00049
30/01/2023	SECTION 1	RX	S1-RX-04	516587.986	453951.8887	BEWHOLME LANE	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, RHDHV T&T HAVE NOT IDENTIFIED ANY SIGNIFICANT ISSUES WITH TRENCHING OF ROAD. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE.	ID-00019	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00050
30/01/2023	SECTION 1	WX	S1-WX-10	516585.045	453950.0797	WATERCOURSE/DITCH	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S1-RX-04	ID-00019	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00051
30/01/2023	SECTION 1	EOX	S1-EOX-18	516584.817	453949.834	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S1-RX-04	ID-00019	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00052
30/01/2023	SECTION 1	UUX	S1-UUX-13	516640.004	453877.2448	BT OPENREACH UNDERGROUND TELECOM UTILITY	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S1-RX-05	ID-00020	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00053
30/01/2023	SECTION 1	UUX	S1-UUX-14	516639.59	453876.9278	BT OPENREACH TELECOM DUCT	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S1-RX-05	ID-00020	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00054
30/01/2023	SECTION 1	EOX	S1-EOX-19	516640.682	453877.9878	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S1-RX-05	ID-00020	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00055
30/01/2023	SECTION 1	RX	S1-RX-05	516636.932	453874.571	BEWHOLME LANE	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, RHDHV T&T HAVE NOT IDENTIFIED ANY SIGNIFICANT ISSUES WITH TRENCHING OF ROAD. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE.	ID-00020	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00056
30/01/2023	SECTION 1	WX	S1-WX-11	516633.568	453871.8899	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S1-RX-05	ID-00020	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00057
30/01/2023	SECTION 1	EOX	S1-EOX-20	516633.139	453871.4921	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S1-RX-05	ID-00020	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00058
30/01/2023	SECTION 1	WX	S1-WX-12	516003.875	453549.035	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00021	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00059
30/01/2023	SECTION 1	EOX	S1-EOX-21	516001.352	453548.194	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S1-WX-12	ID-00021	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00060
30/01/2023	SECTION 1	EOX	S1-EOX-22	515644.93	453315.26	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00022	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00061
30/01/2023	SECTION 1	EOX	S1-EOX-23	515560.101	453260.45	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00023	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00062
30/01/2023	SECTION 1	EOX	S1-EOX-24	515343.611	453116.0861	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S1-RX-06	ID-00024	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00063
30/01/2023	SECTION 1	UUX	S1-UUX-15	515340.978	453115.0932	YORKSHIRE WATER- WATER MAIN	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S1-RX-06	ID-00024	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00064
30/01/2023	SECTION 1	RX	S1-RX-06	515338.351	453114.3766	DUNNINGTON LANE	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, RHDHV T&T HAVE NOT IDENTIFIED ANY SIGNIFICANT ISSUES WITH TRENCHING OF ROAD. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE.	ID-00024	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00065
30/01/2023	SECTION 1	UUX	S1-UUX-16	515336.863	453113.9518	BT OPENREACH TELECOM UTILITY	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S1-RX-06	ID-00024	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00066
30/01/2023	SECTION 1	EOX	S1-EOX-25	515333.177	453112.8335	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S1-RX-06	ID-00024	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00067
30/01/2023	SECTION 1	OUX	S1-OUX-04	515104.755	452994.2665	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00025	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00068
30/01/2023	SECTION 1	WX	S1-WX-13	514805.252	452903.7489	DUNNINGTON SEWER	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00026	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00069
30/01/2023	SECTION 1	EOX	S1-EOX-26	514796.418	452904.5865	HEDGEROW/MATURE TREES	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S1-WX-13	ID-00026	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00070
30/01/2023	SECTION 1	WX	S1-WX-14	514793.964	452904.4619	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S1-WX-13	ID-00026	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00071
30/01/2023	SECTION 1	UUX	S1-UUX-01	514568.161	452837.6395	NATIONAL GRID HIGH PRESSURE GAS MAIN	BURIED	P	Y	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY REQUIRED	ID-00027	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00072
30/01/2023	SECTION 1	EOX	S1-EOX-27	514353.751	452784.1899	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S1-RX-07	ID-00028	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00073
30/01/2023	SECTION 1	RX	S1-RX-07	514345.933	452782.2841	DUNNINGTON LANE	SURFACE	N	Y	P	N	NONE TO DATE	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION. POTENTIAL TO CROSS WITH S1-UUX-01.	ID-00028	2	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00074
30/01/2023	SECTION 2	RX	S2-RX-03	514066.91	452880.8725	DUNNINGTON LANE (HAUL ROAD ACCESS)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00075
30/01/2023	SECTION 2	EOX	S2-EOX-18	514066.131	452872.0987	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00076
30/01/2023	SECTION 2	EOX	S2-EOX-02	514075.701	452593.6306	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S2-OUX-01	ID-00029	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00077

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 2	OUX	S2-OUX-01	514075.52	452592.5468	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00029	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00078
30/01/2023	SECTION 2	RX	S2-RX-04	514364.603	452591.3854	DUNNINGTON LANE (HAUL ROAD ACCESS)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00079
30/01/2023	SECTION 2	OUX	S2-OUX-04	514361.266	452590.9033	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00080
30/01/2023	SECTION 2	EOX	S2-EOX-19	514355.537	452590.9631	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00081
30/01/2023	SECTION 2	EOX	S2-EOX-03	514080.505	452322.6647	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00030	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00082
30/01/2023	SECTION 2	EOX	S2-EOX-04	514117.22	452116.3899	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00031	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00083
30/01/2023	SECTION 2	PAT	S2-PAT-01	514116.982	452112.3152	OS MARKED PATH	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S2-EOX-04	ID-00031	1	Y	N/A		ID-00084
30/01/2023	SECTION 2	WX	S2-WX-01	514152.135	451868.5091	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00032	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00085
30/01/2023	SECTION 2	EOX	S2-EOX-05	514163.74	451504.7	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00033	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00086
30/01/2023	SECTION 2	EOX	S2-EOX-06	514193.621	451102.456	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00034	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00087
30/01/2023	SECTION 2	EOX	S2-EOX-07	514212.661	450909.4281	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S2-WX-02	ID-00035	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00088
30/01/2023	SECTION 2	WX	S2-WX-02	514212.738	450906.9517	WATERCOURSE/DITCH	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00035	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00089
30/01/2023	SECTION 2	EOX	S2-EOX-08	514416.957	450601.0793	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00036	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00090
30/01/2023	SECTION 2	EOX	S2-EOX-09	514573.246	450356.0923	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00037	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00091
30/01/2023	SECTION 2	EOX	S2-EOX-10	514589.212	450311.1555	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00038	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00092
30/01/2023	SECTION 2	EOX	S2-EOX-11	514649.173	450197.6585	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S2-RX-01	ID-00039	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00093
30/01/2023	SECTION 2	UUX	S2-UUX-01	514649.775	450196.4221	BT OPENREACH TELECOM LINE	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S2-RX-01	ID-00039	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00094
30/01/2023	SECTION 2	RX	S2-RX-01	514650.825	450193.4142	BILLINGS LANE	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, RHDHV T&T HAVE NOT IDENTIFIED ANY SIGNIFICANT ISSUES WITH TRENCHING OF ROAD. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE.	ID-00039	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00095
30/01/2023	SECTION 2	UUX	S2-UUX-02	514651.006	450192.9572	YORKSHIRE WATER, WATER MAIN	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S2-RX-01	ID-00039	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00096
30/01/2023	SECTION 2	EOX	S2-EOX-12	514652.26	450189.7574	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S2-RX-01	ID-00039	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00097
30/01/2023	SECTION 2	UUX	S2-UUX-03	514652.324	450188.3961	YORKSHIRE WATER, WATER MAIN- ABANDONED	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S2-RX-01	ID-00039	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00098
30/01/2023	SECTION 2	WX	S2-WX-03	514716.001	450072.2211	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00040	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00099
30/01/2023	SECTION 2	EOX	S2-EOX-13	514717.587	450069.9426	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S2-WX-03	ID-00040	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00100
30/01/2023	SECTION 2	OUX	S2-OUX-02	514729.253	450056.7323	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POSSIBLY CROSSED WITH S2-WX-03	ID-00041	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00101
30/01/2023	SECTION 2	WX	S2-WX-04	514743.461	449765.5444	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00042	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00102
30/01/2023	SECTION 2	EOX	S2-EOX-14	514743.256	449763.848	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S2-WX-04	ID-00042	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00103
30/01/2023	SECTION 2	OUX	S2-OUX-03	514728.905	449567.9858	NORTHERN POWERGRID HIGH VOLTAGE 66kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00043	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00104
30/01/2023	SECTION 2	EOX	S2-EOX-15	514695.148	449301.8024	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S2-WX-05	ID-00044	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00105
30/01/2023	SECTION 2	WX	S2-WX-05	514694.349	449292.2225	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00044	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00106
30/01/2023	SECTION 2	UUX	S2-UUX-07	514865.304	449307.8081	NATIONAL GRID HIGH PRESSURE GAS MAIN (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00107
30/01/2023	SECTION 2	EOX	S2-EOX-01	514765.476	449142.0046	WOODLAND BLOCK NORTH OF CATFOSS ROAD	SURFACE	N	P	P	N	NONE TO DATE	WOODLAND CURRENTLY AVOIDED WITHIN 100m CABLE ROUTE BUT WITHIN 200m CABLE ROUTE. IF CROSSING OF WOODLAND IS REQUIRED THEN THIS WOULD BE ACHIEVED VIA A TRENCHLESS TECHNIQUE.	ID-00045	1	N	N/A	HAUL ROAD WOULD AVOID WOODLAND	ID-00108
30/01/2023	SECTION 2	EOX	S2-EOX-16	514681.354	449092.7743	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S2-RX-02	ID-00046	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00109
30/01/2023	SECTION 2	UUX	S2-UUX-04	514681.576	449091.0424	BT OPENREACH TELECOM LINE	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S2-RX-02	ID-00046	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00110
30/01/2023	SECTION 2	UUX	S2-UUX-05	514681.687	449090.5619	YORKSHIRE WATER, WATER MAIN	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S2-RX-02	ID-00046	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00111
30/01/2023	SECTION 2	RX	S2-RX-02	514682.189	449086.5281	CATFOSS ROAD	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, POTENTIAL FOR TRENCHLESS CROSSING BASED ON RHDHV T&T ASSESSMENT BUT ALL OPTIONS RETAINED FOR NOW. CROSSED WITH S2-EOX-01 IF CROSSING OF WOODLAND REQUIRED. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE.	ID-00046	1	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00112
30/01/2023	SECTION 2	UUX	S2-UUX-06	514682.863	449083.1063	YORKSHIRE WATER, WATER MAIN	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S2-RX-02	ID-00046	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00113
30/01/2023	SECTION 2	EOX	S2-EOX-17	514683.415	449079.4483	HEDGEROW/MATURE TREES	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S2-RX-02	ID-00046	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00114

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 2	EOX	S2-EOX-20	514969.454	449222.6342	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00115
30/01/2023	SECTION 2	RX	S2-RX-03	514971.844	449216.8442	CATFOSS ROAD (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00116
30/01/2023	SECTION 3	EOX	S3-EOX-17	514975.52	449209.39	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00117
30/01/2023	SECTION 3	EOX	S3-EOX-18	514965.868	449148.4571	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00118
30/01/2023	SECTION 3	EOX	S3-EOX-19	515012.052	449083.5213	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00119
30/01/2023	SECTION 3	WX	S3-WX-07	515012.285	449082.5137	WATERCOURSE / DRAIN (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00120
30/01/2023	SECTION 3	EOX	S3-EOX-20	514998.903	449062.804	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00121
30/01/2023	SECTION 3	UUX	S3-UUX-09	514887.788	449007.9379	NATIONAL GRID HIGH PRESSURE GAS MAIN (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00122
30/01/2023	SECTION 3	WX	S3-WX-07	514790.058	449027.1363	WATERCOURSE / DRAIN (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00123
30/01/2023	SECTION 3	EOX	S3-EOX-21	514789.415	449026.239	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00124
30/01/2023	SECTION 3	WX	S3-WX-02	514691.925	448688.4447	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00047		1 Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00125
30/01/2023	SECTION 3	EOX	S3-EOX-01	514692.087	448686.5328	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S3-WX-02	ID-00047		1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00126
30/01/2023	SECTION 3	OUX	S3-OUX-01	514691.324	448678.6735	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	LIKELY TO BE CROSSED WITH S3-WX-02	ID-00047		1 Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00127
30/01/2023	SECTION 3	EOX	S3-EOX-02	514703.376	448281.1057	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S3-RX-02	ID-00048		1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00128
30/01/2023	SECTION 3	RX	S3-RX-02	514703.289	448276.6283	HARSELL LANE	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, RHDHV T&T HAVE NOT IDENTIFIED ANY SIGNIFICANT ISSUES WITH TRENCHING OF ROAD. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE.	ID-00048		1 Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00129
30/01/2023	SECTION 3	EOX	S3-EOX-03	514682.546	448276.4717	TREE	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S3-RX-02. POTENTIAL MICRO SITING OF CABLES WOULD ALLOW FOR RETENTION OF TREE	ID-00048		1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00130
30/01/2023	SECTION 3	EOX	S3-EOX-04	514671.272	447677.0039	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S3-WX-03	ID-00049		1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00131
30/01/2023	SECTION 3	WX	S3-WX-03	514671.372	447680.2306	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00049		1 Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00132
30/01/2023	SECTION 3	EOX	S3-EOX-05	514651.897	447413.5765	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00050		1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00133
30/01/2023	SECTION 3	EOX	S3-EOX-06	514633.45	447130.2551	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00051		1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00134
30/01/2023	SECTION 3	WX	S3-WX-04	514628.79	446988.42	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00052		1 Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00135
30/01/2023	SECTION 3	EOX	S3-EOX-07	514630.161	446981.7809	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S3-WX-04	ID-00052		1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00136
30/01/2023	SECTION 3	WX	S3-WX-05	514602.777	446947.197	WATERCOURSE / DRAIN	SURFACE	P	P	P	P	NONE TO DATE	WATERCOURSE PARALLEL ALONG CABLE ROUTE, THERE MAY BE POTENTIAL OPTIONS TO AVOID IMPACT ON WATERCOURSE, CROSSED WITH S3-WX-04	ID-00052		1 N	N/A	HAUL ROAD CROSSING OF WATERCOURSE WOULD BE ABLE TO BE AVOIDED	ID-00137
30/01/2023	SECTION 3	EOX	S3-EOX-08	514600.167	446946.9111	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	HEDGEROW PARALLEL ALONG CABLE ROUTE, THERE MAY BE POTENTIAL OPTIONS TO AVOID IMPACT ON HEDGEROW, CROSSED WITH S3-WX-04	ID-00052		1 Y	N/A	HAUL ROAD WOULD AVOID HEDGEROW	ID-00138
30/01/2023	SECTION 3	PAT	S3-PAT-01	514616.23	446765.4276	PROW FOOTPATH	SURFACE	Y	P	P	P	NONE TO DATE	POTENTIALLY CROSSED WITH S3-WX-06	ID-00053		1 Y	N/A		ID-00139
30/01/2023	SECTION 3	EOX	S3-EOX-09	514620.298	446719.5492	HEDGEROW/ MATURE TREES	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S3-WX-06	ID-00054		1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00140
30/01/2023	SECTION 3	WX	S3-WX-06	514620.245	446717.9259	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00054		1 Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00141
30/01/2023	SECTION 3	EOX	S3-EOX-10	514586.789	446446.4225	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S3-PRX-01	ID-00055		1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00142
30/01/2023	SECTION 3	OUX	S3-OUX-02	514586.784	446445.8774	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	CROSSED WITH S3-PRX-01	ID-00055		1 Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00143
30/01/2023	SECTION 3	PRX	S3-PRX-01	514587.157	446442.4465	PRIVATE ROAD - ACCESS TO CATFOSS HALL	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00055		1 Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00144
30/01/2023	SECTION 3	UUX	S3-UUX-03	514587.232	446440.7759	BT OPENREACH TELECOM LINE	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S3-PRX-01	ID-00055		1 Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00145
30/01/2023	SECTION 3	EOX	S3-EOX-11	514587.338	446438.686	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S3-PRX-01	ID-00055		1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00146
30/01/2023	SECTION 3	UUX	S3-UUX-04	514587.413	446437.2751	BT OPENREACH TELECOM LINE	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S3-PRX-01	ID-00055		1 Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00147
30/01/2023	SECTION 3	EOX	S3-EOX-22	514462.05	446339.33	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00148
30/01/2023	SECTION 3	RX	S2-RX-03	514457.496	446338.4008	CATWICK HEADS LANE (HAUL ROAD ACCESS)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS OFF ROAD REQUIRED.	ID-00149
30/01/2023	SECTION 3	EOX	S3-EOX-12	514706.795	446261.7205	WOODLAND BLOCK	SURFACE	N	Y	P	N	NONE TO DATE	WOODLAND BLOCK MAY BE ABLE TO BE AVOIDED WITHIN 100m CABLE ROUTE. IF CROSSING OF WOODLAND IS REQUIRED THEN THIS WOULD BE ACHIEVED VIA A TRENCHLESS TECHNIQUE AND CROSSED WITH S3-WX-01.	ID-00056		3 N	N/A	HAUL ROAD WOULD AVOID WOODLAND	ID-00150
30/01/2023	SECTION 3	WX	S3-WX-01	514645.401	446134.1275	CATFOSS DRAIN	SURFACE	P	Y	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY TO BE REQUIRED IN COMBINATION WITH CROSSING OF A1035 (S3-RX-1). SUITABILITY FOR HDD TO BE CONFIRMED AND OTHER TRENCHLESS TECHNIQUE MAY BE REQUIRED. POTENTIAL TO CROSS WITH S3-RX-03	ID-00056		3 P	TEMPORARY BRIDGE	POSSIBLY A LOCKOUT FOR HAUL ROAD, WITH HAUL ROAD DIVERTED TO PUBLIC HIGHWAY. HAUL ROAD CROSSING OF WATERCOURSE POTENTIALLY REQUIRED. TEMPORARY BRIDGE MAY BE REQUIRED DUE TO SIZE OF WATERCOURSE.	ID-00151
30/01/2023	SECTION 3	EOX	S3-EOX-13	514649.715	446121.0739	WOODLAND	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S3-WX-01	ID-00056		3 P	N/A	HAUL ROAD CROSSING OF WOODLAND REQUIRED. WOULD TARGET GAPS IN WOODLAND FOR HAUL ROAD WHERE POSSIBLE.	ID-00152
30/01/2023	SECTION 3	PAT	S3-PAT-02	514658.285	446102.4017	TRACK	SURFACE	P	Y	P	P	NONE TO DATE	CROSSED WITH S3-WX-01	ID-00056		3 P	N/A		ID-00153
30/01/2023	SECTION 3	PAT	S3-PAT-03	514690.748	446068.1219	TRACK	SURFACE	P	P	P	P	NONE TO DATE	PARALLEL ALONG CABLE ROUTE, POTENTIAL TO AVOID OR CROSS WITH S3-RX-01 AND S3-WX-01	ID-00056		3 P	N/A		ID-00154

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 3	EOX	S3-EOX-14	514674.622	446029.9595	MATURE TREES	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S3-RX-01	ID-00056	3	P	N/A	HAUL ROAD CROSSING OF WOODLAND REQUIRED. WOULD TARGET GAPS IN WOODLAND FOR HAUL ROAD WHERE POSSIBLE.	ID-00155
30/01/2023	SECTION 3	EOX	S3-EOX-15	514677.438	446024.2509	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S3-RX-01	ID-00056	3	P	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00156
30/01/2023	SECTION 3	UUX	S3-UUX-05	514679.056	446021.9859	BT OPENREACH TELECOM LINE	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S3-RX-01	ID-00056	3	P	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00157
30/01/2023	SECTION 3	RX	S3-RX-01	514683.93	446014.496	A1035 WEST ROAD	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	TRENCHLESS CROSSING COMMITTED TO. POTENTIAL TO CROSS WITH S3-WX-01.	ID-00056	3	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00158
30/01/2023	SECTION 3	UUX	S3-UUX-06	514682.919	446016.1871	YORKSHIRE WATER SEWERAGE RISING MAIN	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S3-RX-01	ID-00056	3	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00159
30/01/2023	SECTION 3	UUX	S3-UUX-07	514688.438	446009.0186	NORTHERN POWER GIRD 11kV ELECTRICITY LINE	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S3-RX-01	ID-00056	3	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00160
30/01/2023	SECTION 3	UUX	S3-UUX-01	514688.484	446008.9168	NORTHERN POWER GIRD 33kV ELECTRICITY LINE	BURIED	N	Y	P	N	NONE TO DATE	CROSSED WITH S3-RX-01	ID-00056	3	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00161
30/01/2023	SECTION 3	OUX	S3-OUX-02	514688.514	446008.8347	BT OPENREACH TELECOM LINE	OVERHEAD	N	Y	P	P	NONE TO DATE	CROSSED WITH S3-RX-01	ID-00056	3	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00162
30/01/2023	SECTION 3	UUX	S3-UUX-08	514688.595	446008.6692	YORKSHIRE WATER, WATER MAIN	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S3-RX-01	ID-00056	3	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00163
30/01/2023	SECTION 3	EOX	S3-EOX-16	514689.446	446006.1997	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S3-RX-01	ID-00056	3	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00164
30/01/2023	SECTION 3	UUX	S3-UUX-02	514691.738	446002.4237	NORTHERN GAS NETWORKS HIGH PRESSURE GAS MAIN	BURIED	N	Y	P	N	NONE TO DATE	CROSSED WITH S3-RX-01	ID-00056	3	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00165
30/01/2023	SECTION 4	RX	S4-RX-03	514934.817	446058.1965	A1035 WEST ROAD (HAUL ROAD ACCESS)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS OFF ROAD REQUIRED.	ID-00166
30/01/2023	SECTION 4	UUX	S4-UUX-03	514935.444	446055.1996	NORTHERN POWER GIRD 33kV ELECTRICITY LINE (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00167
30/01/2023	SECTION 4	UUX	S4-UUX-04	514935.528	446054.8306	NORTHERN POWER GIRD 11kV ELECTRICITY LINE (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00168
30/01/2023	SECTION 4	OUX	S4-OUX-02	514936.154	446050.3875	BT OPENREACH TELECOM LINE (HAUL ROAD CROSSING)	OVERHEAD	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00169
30/01/2023	SECTION 4	UUX	S4-UUX-05	514936.233	446050.2052	YORKSHIRE WATER, WATER MAIN (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00170
30/01/2023	SECTION 4	UUX	S4-UUX-06	514936.339	446049.8782	NORTHERN GAS NETWORKS HIGH PRESSURE GAS MAIN (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00171
30/01/2023	SECTION 4	EOX	S4-EOX-09	514936.819	446047.0145	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00172
30/01/2023	SECTION 4	EOX	S4-EOX-10	514940.06	445888.8746	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00173
30/01/2023	SECTION 4	WX	S4-WX-02	514720.574	445873.2032	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00057	1	Y		HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00174
30/01/2023	SECTION 4	EOX	S4-EOX-01	514720.876	445870.8387	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S4-WX-02	ID-00057	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00175
30/01/2023	SECTION 4	WX	S4-WX-03	514693.523	445699.4535	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00058	1	Y		HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00176
30/01/2023	SECTION 4	EOX	S4-EOX-02	514693.586	445696.8533	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S4-WX-03	ID-00058	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00177
30/01/2023	SECTION 4	PAT	S4-PAT-01	514677.86	445635.0949	PROW FOOTPATH	SURFACE	P	P	P	P	NONE TO DATE	POTENTIALLY CROSSED IN SAME CROSSING AS S4-RX-01 OR MAY BE ABLE TO BE AVOIDED.	ID-00059	1	Y	N/A		ID-00178
30/01/2023	SECTION 4	EOX	S4-EOX-03	514634.439	445629.3046	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S4-RX-01	ID-00060	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00179
30/01/2023	SECTION 4	UUX	S4-UUX-01	514626.661	445624.4613	BT OPENREACH TELECOM LINE	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S4-RX-01	ID-00060	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00180
30/01/2023	SECTION 4	UUX	S4-UUX-02	514625.94	445623.7686	BT OPENREACH TELECOM LINE	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S4-RX-01	ID-00060	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00181
30/01/2023	SECTION 4	RX	S4-RX-01	514622.118	445619.476	CATWICK HEADS LANE	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, RHDHV T&T HAVE NOT IDENTIFIED ANY SIGNIFICANT ISSUES WITH TRENCHING OF ROAD. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE.	ID-00060	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00182
30/01/2023	SECTION 4	EOX	S4-EOX-04	514616.476	445616.0289	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S4-RX-01	ID-00060	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00183
30/01/2023	SECTION 4	WX	S4-WX-04	514617.887	445617.2491	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S4-RX-01	ID-00060	1	Y		HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00184
30/01/2023	SECTION 4	WX	S4-WX-05	514489.465	445493.8927	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00061	1	Y		HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00185
30/01/2023	SECTION 4	EOX	S4-EOX-05	514489.457	445492.3275	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S4-WX-05	ID-00061	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00186
30/01/2023	SECTION 4	WX	S4-WX-06	514420.977	445446.9788	POND	SURFACE	P	P	P	N	NONE TO DATE	POND IN CENTRE OF CABLE CORRIDOR, MAY BE ABLE TO BE AVOIDED IN CABLE ROUTEING.	ID-00062	1	N	N/A	HAUL ROAD WOULD AVOID POND	ID-00187
30/01/2023	SECTION 4	EOX	S4-EOX-06	514239.85	445298.2876	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00063	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00188
30/01/2023	SECTION 4	OUX	S4-OUX-01	513992.686	444985.0013	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	POTENTIALLY CROSSED WITH S4-RX-02	ID-00064	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00189
30/01/2023	SECTION 4	RX	S4-RX-02	513973.944	444960.5834	RISE LANE	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, RHDHV T&T HAVE NOT IDENTIFIED ANY SIGNIFICANT ISSUES WITH TRENCHING OF ROAD. POTENTIALLY CROSSED WITH S4-WX-01. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE.	ID-00064	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00190
30/01/2023	SECTION 4	EOX	S4-EOX-07	513856.203	444827.5834	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	POTENTIALLY CROSSED WITH S4-WX-01 BUT COULD BE SEPARATE CROSSING OR EVEN AVOIDED	ID-00065	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00191
30/01/2023	SECTION 4	WX	S4-WX-01	513770.762	444769.6779	STREAM DIKE - ENVIRONMENT AGENCY MAIN RIVER	SURFACE	P	Y	P	N	WITHIN ETG MEETING 04/02/2022 THE ENVIRONMENT AGENCY IDENTIFIED STRONG PREFERENCE THAT ALL EA MAIN RIVERS SHOULD BE CROSSED VIA TRENCHLESS TECHNIQUE.	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY TO BE REQUIRED, SUITABILITY FOR HDD TO BE CONFIRMED AND OTHER TRENCHLESS TECHNIQUE MAY BE REQUIRED.	ID-00065	2	P		HAUL ROAD CROSSING OF WATERCOURSE POTENTIALLY REQUIRED. CULVERT LIKELY BUT SUITABILITY OF CULVERTING EA MAIN RIVER TBC.	ID-00192

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 4	EOX	S4-EOX-08	513753.028	444772.1811	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S4-WX-01	ID-00065	2 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00193
30/01/2023	SECTION 5	EOX	S5-EOX-01	513644.475	444671.8779	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S5-PRX-01	ID-00066	1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00194
30/01/2023	SECTION 5	PRX	S5-PRX-01	513642.05	444669.1797	PRIVATE ROAD - ACCESS TO FIELD HOUSE	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHED CROSSING CURRENTLY ASSUMED. MAY BE CROSSED WITH S4-WX-01 WHERE TRENCHLESS CROSSING MAY BE REQUIRED. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00066	1 Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00195
30/01/2023	SECTION 5	UUX	S5-UUX-01	513638.084	444663.7826	BT OPENREACH TELECOM LINE	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S5-PRX-01	ID-00066	1 Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00196
30/01/2023	SECTION 5	EOX	S5-EOX-02	512906.406	444213.5614	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S5-RX-02	ID-00067	1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00197
30/01/2023	SECTION 5	RX	S5-RX-02	512900.206	444210.5062	RISTON ROAD	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, RHDHV T&T HAVE NOT IDENTIFIED ANY SIGNIFICANT ISSUES WITH TRENCHING OF ROAD. POTENTIALLY CROSSED WITH S4-WX-01. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE.	ID-00067	1 Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00198
30/01/2023	SECTION 5	EOX	S5-EOX-03	512895.316	444206.4225	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S5-RX-02	ID-00067	1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00199
30/01/2023	SECTION 5	WX	S5-WX-01	512711.072	444101.6969	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00068	1 Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00200
30/01/2023	SECTION 5	EOX	S5-EOX-04	512077.39	443726.6039	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S5-WX-02 AND POTENTIALLY S5-OOX-01	ID-00069	3 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00201
30/01/2023	SECTION 5	WX	S5-WX-02	512074.992	443725.0559	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S5-OOX-01	ID-00069	3 Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00202
30/01/2023	SECTION 5	OOX	S5-OOX-01	512021.636	443690.6089	PROPOSED SOLAR FARM	SURFACE	P	P	P	N	NONE TO DATE	METHODOLOGY FOR CROSSING OF PROPOSED SOLAR FARM TBC	ID-00069	3 Y	N/A		ID-00203
30/01/2023	SECTION 5	WX	S5-WX-03	511814.165	443556.6638	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S5-OOX-01	ID-00069	3 Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00204
30/01/2023	SECTION 5	EOX	S5-EOX-05	511815.379	443557.4476	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S5-WX-03 AND POTENTIALLY S5-OOX-01	ID-00069	3 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00205
30/01/2023	SECTION 5	OUX	S5-OUX-01	511583.094	443344.9675	NORTHERN POWERGRID HIGH VOLTAGE 11KV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00070	1 Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00206
30/01/2023	SECTION 5	UUX	S5-UUX-02	511467.875	443243.8041	YORKSHIRE WATER, WATER MAIN	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S5-RX-01	ID-00071	2 Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00207
30/01/2023	SECTION 5	UUX	S5-UUX-03	511465.035	443241.829	YORKSHIRE WATER, WATER MAIN	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S5-RX-01	ID-00071	2 Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00208
30/01/2023	SECTION 5	EOX	S5-EOX-06	511471.262	443246.1587	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S5-RX-01	ID-00071	2 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00209
30/01/2023	SECTION 5	RX	S5-RX-01	511460.852	443238.9204	A165 WHITECROSS ROAD	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00071	2 Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00210
30/01/2023	SECTION 5	EOX	S5-EOX-07	511451.853	443232.6626	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S5-RX-01	ID-00071	2 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00211
30/01/2023	SECTION 5	UUX	S5-UUX-04	511454.475	443234.4857	BT OPENREACH TELECOM LINE	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S5-RX-01	ID-00071	2 Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00212
30/01/2023	SECTION 5	OUX	S5-OUX-01	511129.997	443020.4903	NORTHERN POWERGRID HIGH VOLTAGE 11KV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00072	1 Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00213
30/01/2023	SECTION 5	WX	S5-WX-04	511035.197	442972.0005	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S5-OOX-02	ID-00073	3 Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00214
30/01/2023	SECTION 5	OOX	S5-OOX-02	510720.372	442762.6218	PROPOSED SOLAR FARM	SURFACE	P	P	P	N	NONE TO DATE	METHODOLOGY FOR CROSSING OF PROPOSED SOLAR FARM TBC	ID-00073	3 Y	N/A		ID-00215
30/01/2023	SECTION 6	PAT	S6-PAT-01	510619.727	442699.6514	PROW FOOTPATH	SURFACE	P	Y	P	P	NONE TO DATE	CROSSED WITH S6-WX-01 AND S6-WX-02	ID-00073	3 Y	N/A		ID-00216
30/01/2023	SECTION 6	WX	S6-WX-01	510611.898	442694.7531	MONK DIKE - ENVIRONMENT AGENCY MAIN RIVER	SURFACE	P	Y	P	N	WITHIN ETG MEETING 04/02/2022 THE ENVIRONMENT AGENCY IDENTIFIED STRONG PREFERENCE THAT ALL EA MAIN RIVERS SHOULD BE CROSSED VIA TRENCHLESS TECHNIQUE.	ALL OPTIONS AVAILABLE, CROSSED WITH S6-WX-02. TRENCHLESS CROSSING LIKELY TO BE REQUIRED, SUITABILITY FOR HDD TO BE CONFIRMED AND OTHER TRENCHLESS TECHNIQUE MAY BE REQUIRED. POTENTIAL REQUIREMENT TO ALSO CROSS WITH S5-OOX-02.	ID-00073	3 P	TEMPORARY BRIDGE	HAUL ROAD CROSSING OF WATERCOURSE POTENTIALLY REQUIRED. TEMPORARY BRIDGE MAY BE REQUIRED DUE TO SIZE OF WATERCOURSE.	ID-00217
30/01/2023	SECTION 6	UUX	S6-UUX-01	510593.517	442683.253	NORTHERN GAS NETWORKS HIGH PRESSURE GAS MAIN	BURIED	P	Y	P	N	NONE TO DATE	CROSSED WITH S6-WX-01 AND S6-WX-02	ID-00073	3 P	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00218
30/01/2023	SECTION 6	WX	S6-WX-02	510437.709	442585.7692	MEAUX AND ROUTH EAST DRAIN - ENVIRONMENT AGENCY MAIN RIVER	SURFACE	P	Y	P	N	WITHIN ETG MEETING 04/02/2022 THE ENVIRONMENT AGENCY IDENTIFIED STRONG PREFERENCE THAT ALL EA MAIN RIVERS SHOULD BE CROSSED VIA TRENCHLESS TECHNIQUE.	ALL OPTIONS AVAILABLE, CROSSED WITH S6-WX-01. TRENCHLESS CROSSING LIKELY TO BE REQUIRED, SUITABILITY FOR HDD TO BE CONFIRMED AND OTHER TRENCHLESS TECHNIQUE MAY BE REQUIRED. POTENTIAL REQUIREMENT TO ALSO CROSS WITH S5-OOX-02.	ID-00073	3 P	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE POTENTIALLY REQUIRED. CULVERT LIKELY BUT SUITABILITY OF CULVERTING EA MAIN RIVER TBC.	ID-00219
30/01/2023	SECTION 6	EOX	S6-EOX-01	510154.009	442469.3552	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S6-PAT-02	ID-00074	1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00220
30/01/2023	SECTION 6	PAT	S6-PAT-02	510151.374	442467.284	FARM TRACK	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00074	1 Y	N/A		ID-00221
30/01/2023	SECTION 6	PAT	S6-PAT-03	509967.658	442363.9843	FARM TRACK	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00075	1 Y	N/A		ID-00222
30/01/2023	SECTION 6	EOX	S6-EOX-02	509784.958	442232.4725	HEDGEROW	SURFACE	Y	Y	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S6-WX-04	ID-00076	1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00223
30/01/2023	SECTION 6	WX	S6-WX-04	509757.856	442218.1282	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00077	1 Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00224
30/01/2023	SECTION 6	WX	S6-WX-05	509606.593	442105.8876	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00078	1 Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00225
30/01/2023	SECTION 6	EOX	S6-EOX-03	509604.922	442105.3283	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S6-WX-05	ID-00078	1 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00226
30/01/2023	SECTION 6	OUX	S6-OUX-01	509443.438	442031.4659	NORTHERN POWERGRID HIGH VOLTAGE 11KV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00079	1 Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00227
30/01/2023	SECTION 6	EOX	S6-EOX-04	509299.07	442004.3456	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH MEAUX LANE S6-RX-02	ID-00080	2 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00228
30/01/2023	SECTION 6	RX	S6-RX-02	509294.71	442003.5254	MEAUX LANE	SURFACE	N	Y	P	N	NONE TO DATE	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00080	2 Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00229
30/01/2023	SECTION 6	UUX	S6-UUX-03	509291.896	442002.9425	BT OPENREACH TELECOM LINE	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH MEAUX LANE S6-RX-02	ID-00080	2 Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00230
30/01/2023	SECTION 6	EOX	S6-EOX-05	509289.738	442002.8776	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH MEAUX LANE S6-RX-02	ID-00080	2 Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00231
30/01/2023	SECTION 6	PRX	S6-PRX-01	509000.61	442076.4433	PRIVATE ROAD TO POULTRY SHEDS	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00081	2 Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00232

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 6	WX	S6-WX-06	508997.61	442079.36	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S6-PRX-01	ID-00081	2	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00233
30/01/2023	SECTION 6	OUX	S6-OUX-02	508677.686	442325.2141	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S6-RX-01.	ID-00082	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00234
30/01/2023	SECTION 6	OUX	S6-OUX-04	508739.38	442340.84	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE (HAUL ROAD CROSSING)	OVERHEAD	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00235
30/01/2023	SECTION 6	EOX	S6-EOX-06	508521.025	442311.8867	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S6-RX-01	ID-00083	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00236
30/01/2023	SECTION 6	UUX	S6-UUX-04	508519.079	442313.8663	YORKSHIRE WATER, WATER MAIN	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S6-RX-01	ID-00083	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00237
30/01/2023	SECTION 6	UUX	S6-UUX-05	508516.688	442316.6781	BT OPENREACH TELECOM LINE	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S6-RX-01	ID-00083	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00238
30/01/2023	SECTION 6	UUX	S6-UUX-06	508515.335	442317.6455	KCOM GROUP TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S6-RX-01	ID-00083	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00239
30/01/2023	SECTION 6	RX	S6-RX-01	508513.291	442319.8509	A1035	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00083	2	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00240
30/01/2023	SECTION 6	UUX	S6-UUX-07	508511.63	442322.3533	BT OPENREACH TELECOM LINE	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S6-RX-01	ID-00083	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00241
30/01/2023	SECTION 6	UUX	S6-UUX-08	508504.725	442328.9359	BT OPENREACH TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S6-RX-01	ID-00083	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00242
30/01/2023	SECTION 6	EOX	S6-EOX-07	508494.568	442338.3985	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S6-RX-01	ID-00083	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00243
30/01/2023	SECTION 6	EOX	S6-EOX-11	508714.406	442488.9631	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00244
30/01/2023	SECTION 6	UUX	S6-UUX-10	508712.033	442491.2134	YORKSHIRE WATER, WATER MAIN (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00245
30/01/2023	SECTION 6	UUX	S6-UUX-11	508709.478	442493.2132	BT OPENREACH TELECOM LINE (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00246
30/01/2023	SECTION 6	RX	S6-RX-03	508706.517	442495.9297	A1035 (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00247
30/01/2023	SECTION 6	UUX	S6-UUX-12	508701.531	442500.8545	BT OPENREACH TELECOM LINE (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00248
30/01/2023	SECTION 6	EOX	S6-EOX-12	508698.492	442502.6699	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00249
30/01/2023	SECTION 6	WX	S6-WX-07	508260.97	442594.8	WATERCOURSE / DRAIN	SURFACE	P	Y	P	P	NONE TO DATE	CROSSED WITH S6-UUX-01.	ID-00084	2	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00250
30/01/2023	SECTION 6	UUX	S6-UUX-02	508209.632	442583.6428	ONSHORE EXPORT CABLES OF DOGGER BANK A & B OFFSHORE WIND FARMS	BURIED	P	Y	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY TO BE REQUIRED, SUITABILITY FOR HDD TO BE CONFIRMED AND OTHER TRENCHLESS TECHNIQUE MAY BE REQUIRED.	ID-00084	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00251
30/01/2023	SECTION 6	RX	S6-PRX-02	507933.305	442786.3151	PRIVATE ROAD	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00085	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00252
30/01/2023	SECTION 6	EOX	S6-EOX-08	507930.348	442788.8447	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S6-PRX-02	ID-00085	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00253
30/01/2023	SECTION 6	OUX	S6-OUX-03	507766.897	442860.7246	NORTHERN POWERGRID HIGH VOLTAGE 132kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00086	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00254
30/01/2023	SECTION 6	EOX	S6-EOX-09	507376.271	442942.8628	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	CROSSED WITH S6-WX-08	ID-00087	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00255
30/01/2023	SECTION 6	WX	S6-WX-08	507374.951	442940.5569	WATERCOURSE / DRAIN	SURFACE	P	P	P	P	NONE TO DATE	WATERCOURSE PARALLEL ALONG ONSHORE CABLE ROUTE, REQUIREMENT FOR CROSSING TBC	ID-00087	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00256
30/01/2023	SECTION 6	UUX	S6-UUX-09	507310.817	443037.3398	YORKSHIRE WATER, WATER MAIN	BURIED	P	Y	P	P	NONE TO DATE	CROSSED WITH S6-WX-03	ID-00088	2	P	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00257
30/01/2023	SECTION 6	EOX	S6-EOX-10	507290.52	443043.3397	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S6-WX-03	ID-00088	2	P	N/A	HAUL ROAD CROSSING OF HEDGEROW POTENTIALLY REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00258
30/01/2023	SECTION 6	WX	S6-WX-03	507285.109	443044.9392	HOLDERNESS DRAIN - ENVIRONMENT AGENCY MAIN RIVER	SURFACE	P	Y	P	N	WITHIN ETG MEETING 04/02/2022 THE ENVIRONMENT AGENCY IDENTIFIED STRONG PREFERENCE THAT ALL EA MAIN RIVERS SHOULD BE CROSSED VIA TRENCHLESS TECHNIQUE.	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY TO BE REQUIRED, SUITABILITY FOR HDD TO BE CONFIRMED AND OTHER TRENCHLESS TECHNIQUE MAY BE REQUIRED.	ID-00088	2	P	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE POTENTIALLY REQUIRED. CULVERT LIKELY BUT SUITABILITY OF CULVERTING EA MAIN RIVER TBC.	ID-00259
30/01/2023	SECTION 7	WX	S7-WX-01	507233.57	442954.743	WATERCOURSE / DRAIN	SURFACE	P	P	P	P	NONE TO DATE	WATERCOURSE PARALLEL ALONG ONSHORE CABLE ROUTE, REQUIREMENT FOR CROSSING TBC	ID-00089	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00260
30/01/2023	SECTION 7	EOX	S7-EOX-01	507231.943	442954.2781	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	CROSSED WITH S7-WX-01	ID-00089	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00261
30/01/2023	SECTION 7	EOX	S7-EOX-02	507066.88	443017.8563	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00090	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00262
30/01/2023	SECTION 7	EOX	S7-EOX-03	506890.691	443003.0948	MATURE TREE	SURFACE	P	P	P	N	NONE TO DATE	TREE ON THE EDGE OF THE CORRIDOR WILL IDEALLY BE AVOIDED BY CABLE TRENCH AND HAUL ROAD	ID-00091	1	N	N/A	HAUL ROAD WOULD AVOID WOODLAND	ID-00263
30/01/2023	SECTION 7	EOX	S7-EOX-04	506772.225	442894.356	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00092	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00264
30/01/2023	SECTION 7	OUX	S7-OUX-01	506627.781	442797.4296	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, POTENTIALLY CROSSED WITH S7-RX-01	ID-00093	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00265
30/01/2023	SECTION 7	WX	S7-WX-02	506605.145	442784.4718	WATERCOURSE / DRAIN	SURFACE	P	Y	P	P	NONE TO DATE	CROSSED WITH S7-RX-01	ID-00094	2	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00266
30/01/2023	SECTION 7	EOX	S7-EOX-05	506604.285	442783.7562	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S7-RX-01	ID-00094	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00267
30/01/2023	SECTION 7	RX	S7-RX-01	506600.707	442781.1455	ESKE LANE	SURFACE	P	Y	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING MAY BE REQUIRED, TRENCH CROSSING WOULD REQUIRE RETENTION OF SINGLE WORKING LANE OR DIVERSION TO MAINTAIN ACCESS.	ID-00094	2	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00268
30/01/2023	SECTION 7	UUX	S7-UUX-01	506596.923	442779.2688	BT OPENREACH TELECOM LINE	BURIED	P	Y	P	P	NONE TO DATE	CROSSED WITH S7-RX-01	ID-00094	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00269
30/01/2023	SECTION 7	EOX	S7-EOX-06	506597.724	442779.6451	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S7-RX-01	ID-00094	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00270

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 7	EOX	S7-EOX-07	506253.121	442664.878	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00095	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00271
30/01/2023	SECTION 7	EOX	S7-EOX-08	506054.924	442665.1875	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S7-WX-03	ID-00096	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00272
30/01/2023	SECTION 7	WX	S7-WX-03	506053.167	442665.5056	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00096	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00273
30/01/2023	SECTION 7	OUX	S7-OUX-02	505916.156	442665.3428	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, CROSSED WITH S7-EOX-09	ID-00097	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00274
30/01/2023	SECTION 7	EOX	S7-EOX-09	505906.084	442664.7471	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00097	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00275
30/01/2023	SECTION 7	EOX	S7-EOX-10	505615.924	442693.2618	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00098	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00276
30/01/2023	SECTION 7	EOX	S7-EOX-11	505465.659	442706.965	MATURE TREE	SURFACE	P	Y	P	N	NONE TO DATE	MATURE TREES ALONGSIDE WATERCOURSE MAY BE ABLE TO BE AVOIDED OR CROSSED WITH S7-WX-03. WILL BE CROSSED WITH TURF GUTTER CROSSING S7-WX-04	ID-00099	3	P	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00277
30/01/2023	SECTION 7	WX	S7-WX-04	505463.276	442706.6449	TURF GUTTER	SURFACE	P	Y	P	P	NONE TO DATE	ALL OPTIONS ARE AVAILABLE . TRENCHLESS POTENTIALLY COMBINED WITH S8-WX-01	ID-00099	3	P	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00278
30/01/2023	SECTION 7	EOX	S7-EOX-12	505390.188	442699.9574	HEDGEROW/ TREE LINE	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S8-WX-01	ID-00099	3	N	N/A	HAUL ROAD CROSSING OF HEDGEROW NOT REQUIRED AS NO HAUL ROAD CONTINUITY ASSUMED ACROSS RIVER HULL.	ID-00279
30/01/2023	SECTION 8	PAT	S8-PAT-01	505376.955	442694.1202	PROW FOOTPATH	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S8-WX-01	ID-00099	3	N	N/A		ID-00280
30/01/2023	SECTION 8	WX	S8-WX-01	505347.208	442692.5236	RIVER HULL - ENVIRONMENT AGENCY MAIN RIVER	SURFACE	N	Y	P	N	WITHIN ETG MEETING 04/02/2022 THE ENVIRONMENT AGENCY IDENTIFIED STRONG PREFERENCE THAT ALL EA MAIN RIVERS SHOULD BE CROSSED VIA TRENCHLESS TECHNIQUE.	MAJOR WATERCOURSE - TRENCHLESS CROSSING ASSUMED.	ID-00099	3	N	N/A	NO HAUL ROAD CROSSING OF WATERCOURSE REQUIRED.	ID-00281
30/01/2023	SECTION 8	PAT	S8-PAT-02	505317.484	442688.4319	PROW FOOTPATH	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S8-WX-01	ID-00099	3	N	N/A		ID-00282
30/01/2023	SECTION 8	PAT	S8-PAT-03	505307.426	442688.5008	PROW BRIDLEWAY	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S8-WX-01	ID-00099	3	N	N/A		ID-00283
30/01/2023	SECTION 8	UUX	S8-UUX-01	505299.227	442688.2725	NORTHERN POWERGRID HIGH VOLTAGE 11kV UNDERGROUND POWER LINE	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S8-WX-01	ID-00099	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00284
30/01/2023	SECTION 8	WX	S8-WX-02	505291.623	442688.491	BEVERLY AND BARNSTON DRAIN - ENVIRONMENT AGENCY MAIN RIVER	SURFACE	N	Y	P	N	WITHIN ETG MEETING 04/02/2022 THE ENVIRONMENT AGENCY IDENTIFIED STRONG PREFERENCE THAT ALL EA MAIN RIVERS SHOULD BE CROSSED VIA TRENCHLESS TECHNIQUE.	CROSSED WITH S8-WX-01	ID-00099	3	N	N/A	NO HAUL ROAD CROSSING OF WATERCOURSE REQUIRED.	ID-00285
30/01/2023	SECTION 8	OUX	S8-OUX-01	504814.063	442559.8225	NORTHERN POWERGRID HIGH VOLTAGE 66kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00100	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00286
30/01/2023	SECTION 8	RX	S8-RX-01	505280.16	441689.8268	A1035 (HAUL ROAD ACCESS)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS OFF ROAD REQUIRED.	ID-00287
30/01/2023	SECTION 8	EOX	S8-EOX-13	505274.59	441698.0895	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00288
30/01/2023	SECTION 8	EOX	S8-EOX-14	505228.58	441794.8001	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00289
30/01/2023	SECTION 8	WX	S8-WX-09	505224.678	441800.2967	WATERCOURSE / DRAIN (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00290
30/01/2023	SECTION 8	EOX	S8-EOX-15	504990.069	442252.9226	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00291
30/01/2023	SECTION 8	WX	S8-WX-10	504989.469	442253.9676	WATERCOURSE / DRAIN (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00292
30/01/2023	SECTION 8	WX	S8-WX-11	504836.67	442536.9	SOUTH BULLOCK DIKE (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00293
30/01/2023	SECTION 8	WX	S8-WX-03	504503.488	442400.0834	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00101	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00294
30/01/2023	SECTION 8	EOX	S8-EOX-01	504501.651	442398.8005	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED IN SAME CROSSING AS S8-WX-03	ID-00101	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00295
30/01/2023	SECTION 8	EOX	S8-EOX-02	504508.999	442351.8693	WOODLAND	SURFACE	P	P	P	N	NONE TO DATE	PATCH OF WOODLAND ON THE SOUTHERN EDGE OF THE CABLE CORRIDOR, MAY BE ABLE TO BE AVOIDED IN CABLE ROUTEING / HAUL ROAD	ID-00102	1	N	N/A	HAUL ROAD WOULD AVOID WOODLAND	ID-00296
30/01/2023	SECTION 8	EOX	S8-EOX-03	504435.438	442315.2266	WOODLAND	SURFACE	P	P	P	N	NONE TO DATE	PATCH OF WOODLAND ON THE SOUTHERN EDGE OF THE CABLE CORRIDOR PROJECT WOULD AIM TO AVOID DAMAGE TO THESE TREES WITH CABLE TRENCH AND HAUK ROAD ALIGNMENT.	ID-00103	1	N	N/A	HAUL ROAD WOULD AVOID WOODLAND	ID-00297
30/01/2023	SECTION 8	EOX	S8-EOX-04	504346.173	442309.1654	WOODLAND	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S8-WX-04	ID-00104	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00298
30/01/2023	SECTION 8	WX	S8-WX-04	504330.103	442302.5079	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00104	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00299
30/01/2023	SECTION 8	WX	S8-WX-05	504231.732	442183.3676	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00105	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00300
30/01/2023	SECTION 8	EOX	S8-EOX-05	504231.306	442180.1774	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S8-WX-05	ID-00105	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00301
30/01/2023	SECTION 8	OUX	S8-OUX-02	503977.129	442143.4469	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00106	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00302
30/01/2023	SECTION 8	OUX	S8-OUX-03	503815.68	442115.896	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00107	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00303
30/01/2023	SECTION 8	EOX	S8-EOX-06	503673.194	442109.1869	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S8-UTX-01	ID-00108	3	N	N/A	HAUL ROAD CROSSING OF HEDGEROW NOT REQUIRED AS NO HAUL ROAD CONTINUITY ASSUMED ACROSS RAILWAY LINE	ID-00304
30/01/2023	SECTION 8	UTX	S8-UTX-01	503664.493	442109.0032	NETWORK RAIL RAILWAY	SURFACE	N	Y	P	N	NONE TO DATE	TRENCHLESS CROSSING REQUIRED FOR RAILWAY	ID-00108	3	N	N/A		ID-00305
30/01/2023	SECTION 8	EOX	S8-EOX-07	503655.457	442108.8193	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S8-UTX-01	ID-00108	3	N	N/A	HAUL ROAD CROSSING OF HEDGEROW NOT REQUIRED AS NO HAUL ROAD CONTINUITY ASSUMED ACROSS RAILWAY LINE	ID-00306
30/01/2023	SECTION 9	WX	S9-WX-02	503540.063	442135.4261	POND	SURFACE	P	P	P	N	NONE TO DATE	POND WITHIN CABLE CORRIDOR, MAY BE ABLE TO BE AVOIDED IN CABLE ROUTEING. IF TO BE CROSSED WOULD BE CROSSED WITH S9-EOX-01	ID-00109	1	N	N/A	HAUL ROAD WOULD AVOID POND	ID-00307
30/01/2023	SECTION 9	EOX	S9-EOX-01	503524.241	442105.5185	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00109	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00308
30/01/2023	SECTION 9	OUX	S9-OUX-01	503502.214	442104.7615	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, CROSSED WITH S9-EOX-01	ID-00109	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00309
30/01/2023	SECTION 9	PAT	S9-PAT-02	503487.067	442103.7047	PROW FOOTPATH	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, CROSSED WITH S9-EOX-01	ID-00109	1	Y	N/A		ID-00310
30/01/2023	SECTION 9	EOX	S9-EOX-02	503427.042	442079.9225	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00110	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00311

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 9	UUX	S9-UUX-01	503199.344	441960.2564	BT OPENREACH TELECOM LINE	BURIED	Y	P	P	P	NONE TO DATE	CROSSED IN SAME CROSSING AS S9-WX-03	ID-00111	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00312
30/01/2023	SECTION 9	WX	S9-WX-03	503197.556	441959.5359	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00111	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00313
30/01/2023	SECTION 9	WX	S9-WX-04	503046.281	441831.6414	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00112	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00314
30/01/2023	SECTION 8	OUX	S8-OUX-04	503980.257	441870.2607	NORTHERN POWERGRID HIGH VOLTAGE 11KV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00113	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00315
30/01/2023	SECTION 8	WX	S8-WX-06	503989.832	441831.2197	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, REQUIREMENT FOR CROSSING DEPENDANT ON FINAL CABLE ROUTE ALIGNMENT	ID-00114	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00316
30/01/2023	SECTION 8	RX	S8-RX-02	504620.17	441164.9	A1035 (HAUL ROAD ACCESS)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS OFF ROAD REQUIRED.	ID-00317
30/01/2023	SECTION 8	WX	S8-WX-12	504614.97	441174.3	WATERCOURSE / DRAIN (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00318
30/01/2023	SECTION 8	EOX	S8-EOX-16	504612.905	441177.1565	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00319
30/01/2023	SECTION 8	WX	S8-WX-13	504330.073	441593.3749	WATERCOURSE / DRAIN (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC. SUITABILITY OF EXISTING CROSSING TBC.	ID-00320
30/01/2023	SECTION 8	PAT	S8-PAT-06	504311.16	441593.96	TRACK (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A		ID-00321
30/01/2023	SECTION 8	WX	S8-WX-14	504304.574	441594.2723	SOUTH BULLOCK DIKE (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC. SUITABILITY OF EXISTING CROSSING TBC.	ID-00322
v	SECTION 8	EOX	S8-EOX-08	503934.964	441831.0376	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S8-PAT-04	ID-00115	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00323
	30/01/2023	SECTION 8	PAT	503938.265	441832.1973	TRACK	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00115	1	Y	N/A		ID-00324
30/01/2023	SECTION 8	OUX	S8-OUX-05	503981.035	441766.7279	NORTHERN POWERGRID HIGH VOLTAGE 11KV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, REQUIREMENT FOR CROSSING DEPENDANT ON FINAL CABLE ROUTE ALIGNMENT	ID-00116	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00325
30/01/2023	SECTION 8	WX	S8-WX-07	503962.245	441745.3844	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, REQUIREMENT FOR CROSSING DEPENDANT ON FINAL CABLE ROUTE ALIGNMENT	ID-00117	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00326
30/01/2023	SECTION 8	EOX	S8-EOX-09	503957.4	441743.5942	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S8-WX-07	ID-00117	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00327
30/01/2023	SECTION 8	PAT	S8-PAT-05	503894.388	441725.5715	TRACK	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S8-WX-08	ID-00118	1	Y	N/A		ID-00328
30/01/2023	SECTION 8	WX	S8-WX-08	503889.04	441729.8	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED, REQUIREMENT FOR CROSSING DEPENDANT ON FINAL CABLE ROUTE ALIGNMENT	ID-00118	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00329
30/01/2023	SECTION 8	EOX	S8-EOX-10	503890.561	441729.0232	MATURE TREES	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S8-WX-08	ID-00118	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00330
30/01/2023	SECTION 8	EOX	S8-EOX-11	503693.094	441702.4711	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S8-UTX-02	ID-00119	3	N	N/A	HAUL ROAD CROSSING OF HEDGEROW NOT REQUIRED AS NO HAUL ROAD CONTINUITY ASSUMED ACROSS RAILWAY LINE	ID-00331
30/01/2023	SECTION 8	UTX	S8-UTX-02	503684.575	441702.0389	NETWORK RAIL RAILWAY	SURFACE	N	Y	P	N	NONE TO DATE	TRENCHLESS CROSSING REQUIRED FOR RAILWAY	ID-00119	3	N	N/A		ID-00332
30/01/2023	SECTION 8	EOX	S8-EOX-12	503675.732	441701.1797	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S8-UTX-02	ID-00119	3	N	N/A	HAUL ROAD CROSSING OF HEDGEROW NOT REQUIRED AS NO HAUL ROAD CONTINUITY ASSUMED ACROSS RAILWAY LINE	ID-00333
30/01/2023	SECTION 9	PAT	S9-PAT-03	503539.349	441708.9532	PROW FOOTPATH	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S9-WX-05	ID-00120	1	Y	N/A		ID-00334
30/01/2023	SECTION 9	WX	S9-WX-05	503531.344	441709.4129	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING LIKELY	ID-00120	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00335
30/01/2023	SECTION 9	EOX	S9-EOX-03	503535.869	441709.0377	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S9-WX-05	ID-00120	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00336
30/01/2023	SECTION 9	EOX	S9-EOX-04	503505.373	441710.6972	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED IN SAME CROSSING AS S9-WX-06	ID-00121	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00337
30/01/2023	SECTION 9	WX	S9-WX-06	503508.489	441710.6059	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00121	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00338
30/01/2023	SECTION 9	EOX	S9-EOX-05	503496.381	441678.4583	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00122	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00339
30/01/2023	SECTION 9	PAT	S9-PAT-04	503494.1	441678.7686	PROW FOOTPATH	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S9-EOX-05	ID-00122	1	Y	N/A		ID-00340
30/01/2023	SECTION 9	WX	S9-WX-07	503233.114	441638.5984	SISTERBECK DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00123	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00341
30/01/2023	SECTION 9	EOX	S9-EOX-06	503227.63	441638.0028	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S9-WX-07	ID-00123	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00342
30/01/2023	SECTION 9	EOX	S9-EOX-07	503023.485	441603.0593	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S9-PRX-01	ID-00124	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00343
30/01/2023	SECTION 9	PRX	S9-PRX-01	503019.513	441603.2927	CARR ROAD - POTENTIAL PRIVATE ROAD	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. STATUS OF PRIVATE ROAD WOULD NEED TO BE CONFIRMED. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00124	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00344
30/01/2023	SECTION 9	UUX	S9-UUX-02	503012.261	441603.147	KCOM GROUP TELECOM DUCT	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S9-PRX-01	ID-00124	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00345
30/01/2023	SECTION 9	EOX	S9-EOX-08	503009.468	441603.1429	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S9-PRX-01	ID-00124	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00346
30/01/2023	SECTION 9	RX	S9-RX-01	502976.92	441425.85	INGS ROAD (HAUL ROAD ACCESS)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS OFF ROAD REQUIRED.	ID-00347
30/01/2023	SECTION 9	UUX	S9-UUX-03	502977.863	441426.1255	KCOM GROUP TELECOM DUCT (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00348
30/01/2023	SECTION 9	EOX	S9-EOX-18	502982.894	441427.8527	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00349
30/01/2023	SECTION 9	UUX	S9-UUX-04	502961.447	441448.2081	KCOM GROUP TELECOM DUCT (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00350
30/01/2023	SECTION 9	RX	S9-RX-02	502961.839	441449.4133	INGS ROAD (HAUL ROAD ACCESS)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS OFF ROAD REQUIRED.	ID-00351
30/01/2023	SECTION 9	EOX	S9-EOX-19	502964.363	441452.3227	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00352
30/01/2023	SECTION 9	EOX	S9-EOX-09	502745.32	441648.69	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S9-WX-08	ID-00125	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00353
30/01/2023	SECTION 9	WX	S9-WX-08	502746.377	441648.4017	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00125	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00354
30/01/2023	SECTION 9	PAT	S9-PAT-05	502741.234	441649.3452	PROW FOOTPATH / TRACK	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S9-WX-08	ID-00125	1	Y	N/A		ID-00355
30/01/2023	SECTION 9	EOX	S9-EOX-10	502703.66	441651.48	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00126	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00356
30/01/2023	SECTION 9	EOX	S9-EOX-11	502781.964	441575.6112	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S9-PRX-02	ID-00127	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00357

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 9	PRX	S9-PRX-02	502776.338	441572.8735	INGS ROAD - POTENTIAL PRIVATE ROAD	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. STATUS OF PRIVATE ROAD WOULD NEED TO BE CONFIRMED. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00127	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00358
30/01/2023	SECTION 9	EOX	S9-EOX-12	502772.658	441570.0784	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S9-PRX-02	ID-00127	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00359
30/01/2023	SECTION 9	EOX	S9-EOX-13	502599.19	441622.3019	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S9-WX-09	ID-00128	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00360
30/01/2023	SECTION 9	WX	S9-WX-09	502600.709	441622.6614	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00128	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00361
30/01/2023	SECTION 9	EOX	S9-EOX-14	502551.7	441582.748	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	CROSSED WITH S9-WX-10	ID-00129	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00362
30/01/2023	SECTION 9	WX	S9-WX-10	502551.987	441581.3061	WATERCOURSE / DRAIN	SURFACE	P	P	P	P	NONE TO DATE	WATERCOURSE PARALLEL ALONG ONSHORE CABLE ROUTE, REQUIREMENT FOR CROSSING MAY BE ABLE TO BE AVOIDED.	ID-00129	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00363
30/01/2023	SECTION 9	WX	S9-WX-11	502507.108	441609.7805	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00130	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00364
30/01/2023	SECTION 9	EOX	S9-EOX-15	502505.389	441609.6743	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S9-WX-11	ID-00130	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00365
30/01/2023	SECTION 9	EOX	S9-EOX-16	502406.366	441576.9128	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S9-WX-01	ID-00131	3	N	N/A	HAUL ROAD CROSSING OF HEDGEROW NOT REQUIRED AS NO HAUL ROAD CONTINUITY ASSUMED ACROSS HISTORIC RAILWAY LINE ON EMBANKMENT	ID-00366
30/01/2023	SECTION 9	WX	S9-WX-01	502405.126	441562.185	CATCHWATER DRAIN - ENVIRONMENT AGENCY MAIN RIVER	SURFACE	P	Y	P	N	WITHIN ETG MEETING 04/02/2022 THE ENVIRONMENT AGENCY IDENTIFIED STRONG PREFERENCE THAT ALL EA MAIN RIVERS SHOULD BE CROSSED VIA TRENCHLESS TECHNIQUE.	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY TO BE REQUIRED DUE TO PRESENCE OF EMBANKMENT, SUITABILITY FOR HDD TO BE CONFIRMED AND OTHER TRENCHLESS TECHNIQUE MAY BE REQUIRED.	ID-00131	3	P	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE POTENTIALLY REQUIRED. CULVERT LIKELY BUT SUITABILITY OF CULVERTING EA MAIN RIVER TBC.	ID-00367
30/01/2023	SECTION 9	EOX	S9-EOX-17	502397.415	441560.6529	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S9-WX-01	ID-00131	3	N	N/A	HAUL ROAD CROSSING OF HEDGEROW NOT REQUIRED AS NO HAUL ROAD CONTINUITY ASSUMED ACROSS HISTORIC RAILWAY LINE ON EMBANKMENT	ID-00368
30/01/2023	SECTION 9	PAT	S9-PAT-01	502382.299	441558.7634	PROW FOOTPATH ALONG HISTORIC RAILWAY LINE ON EMBANKMENT	SURFACE	P	Y	P	P	NONE TO DATE	CROSSED WITH S9-WX-01	ID-00131	3	N	N/A		ID-00369
30/01/2023	SECTION 9	EOX	S9-EOX-18	502370.042	441555.9546	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S9-WX-01	ID-00131	3	N	N/A	HAUL ROAD CROSSING OF HEDGEROW NOT REQUIRED AS NO HAUL ROAD CONTINUITY ASSUMED ACROSS HISTORIC RAILWAY LINE ON EMBANKMENT	ID-00370
30/01/2023	SECTION 10	OUX	S10-OUX-01	502353.567	441550.0535	NORTHERN POWERGRID HIGH VOLTAGE 11KV OVERHEAD POWER LINE	SURFACE	P	Y	P	P	NONE TO DATE	CROSSED WITH S9-WX-01	ID-00131	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00371
30/01/2023	SECTION 10	EOX	S10-EOX-01	502023.95	441486.45	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S10-RX-01	ID-00132	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00372
30/01/2023	SECTION 10	UUX	S10-UUX-04	502020.426	441486.083	YORKSHIRE WATER- WATER MAIN	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S10-RX-01	ID-00132	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00373
30/01/2023	SECTION 10	UUX	S10-UUX-05	502019.054	441485.9124	BT OPENREACH TELECOM UTILITY	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S10-RX-01	ID-00132	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00374
30/01/2023	SECTION 10	RX	S10-RX-01	502013.449	441484.9937	A164 DRIFFIELD ROAD	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00132	2	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00375
30/01/2023	SECTION 10	UUX	S10-UUX-01	502008.177	441484.5198	NORTHERN GAS NETWORKS MEDIUM PRESSURE GAS MAIN	BURIED	N	Y	P	N	NONE TO DATE	CROSSED WITH S10-RX-01	ID-00132	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00376
30/01/2023	SECTION 10	UUX	S10-UUX-06	502005.328	441483.8369	KCOM GROUP TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S10-RX-01	ID-00132	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00377
30/01/2023	SECTION 10	EOX	S10-EOX-02	502002.73	441483.361	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S10-RX-01	ID-00132	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00378
30/01/2023	SECTION 10	EOX	S10-EOX-03	501964.13	441369.8834	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	HEDGEROW ON SOUTHERN BOUNDARY OF CABLE CORRIDOR, MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CABLE ROUTEING. HAUL ROAD CROSSING OF HEDGEROW MAY BE NEEDED FOR TCC.	ID-00132	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00379
30/01/2023	SECTION 10	EOX	S10-EOX-04	501589.726	441397.0013	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00132	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00380
30/01/2023	SECTION 10	EOX	S10-EOX-05	501255.424	441362.476	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00133	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00381
30/01/2023	SECTION 10	EOX	S10-EOX-06	500972.124	441174.6031	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	HEDGEROW PARALLEL ALONG ONSHORE CABLE ROUTE, REQUIREMENT FOR CROSSING MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CABLE ROUTE ALIGNMENT	ID-00134	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00382
30/01/2023	SECTION 10	EOX	S10-EOX-07	500999.653	440997.0399	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S10-RX-02	ID-00135	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00383
30/01/2023	SECTION 10	UUX	S10-UUX-02	500999.524	440996.1586	NORTHERN GAS NETWORKS MEDIUM PRESSURE GAS MAIN	BURIED	N	Y	P	N	NONE TO DATE	CROSSED WITH S10-RX-02	ID-00135	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00384
30/01/2023	SECTION 10	UUX	S10-UUX-07	500999.394	440995.2764	KCOM GROUP TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S10-RX-02	ID-00135	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00385
30/01/2023	SECTION 10	UUX	S10-UUX-08	500998.77	440991.0353	YORKSHIRE WATER- WATER MAIN - ABANDONED	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S10-RX-02	ID-00135	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00386
30/01/2023	SECTION 10	RX	S10-RX-02	500998.089	440986.4031	A1035 CONSTITUTION HILL	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00135	2	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00387
30/01/2023	SECTION 10	UUX	S10-UUX-09	500996.759	440977.3575	YORKSHIRE WATER- WATER MAIN	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S10-RX-02	ID-00135	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00388
30/01/2023	SECTION 10	EOX	S10-EOX-08	500996.607	440976.3262	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S10-RX-02	ID-00135	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00389
30/01/2023	SECTION 10	OUX	S10-OUX-02	500999.989	440857.1392	NORTHERN POWERGRID HIGH VOLTAGE 11KV OVERHEAD POWER LINE	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00136	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00390
30/01/2023	SECTION 10	WX	S10-WX-01	501031.288	440602.8033	FIELD DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00137	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00391
30/01/2023	SECTION 10	EOX	S10-EOX-09	501031.33	440600.8835	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S10-WX-01	ID-00137	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00392
30/01/2023	SECTION 10	EOX	S10-EOX-10	501012.713	440362.2222	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00138	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00393
30/01/2023	SECTION 10	OUX	S10-OUX-03	501012.872	439855.3814	NORTHERN POWERGRID HIGH VOLTAGE 11KV OVERHEAD POWER LINE	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00139	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00394

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 10	EOX	S10-EOX-11	500977.837	439742.0365	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S10-RX-03	ID-00140	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00395
30/01/2023	SECTION 10	UUX	S10-UUX-03	500977.819	439742.0026	NORTHERN GAS NETWORKS MEDIUM PRESSURE GAS MAIN	BURIED	N	Y	P	N	NONE TO DATE	CROSSED WITH S10-RX-03	ID-00140	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00396
30/01/2023	SECTION 10	OUX	S10-OUX-04	500977.621	439741.6274	BT OPENREACH OVERHEAD TELECOM LINE	OVERHEAD	N	Y	P	P	NONE TO DATE	CROSSED WITH S10-RX-03	ID-00140	2	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00397
30/01/2023	SECTION 10	UUX	S10-UUX-10	500977.16	439740.7532	KCOM GROUP TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S10-RX-03	ID-00140	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00398
30/01/2023	SECTION 10	RX	S10-RX-03	500972.868	439732.6127	A1174	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00140	2	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00399
30/01/2023	SECTION 10	EOX	S10-EOX-12	500964.441	439716.6309	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S10-RX-03	ID-00140	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00400
30/01/2023	SECTION 10	EOX	S10-EOX-13	500689.473	439771.7844	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00401
30/01/2023	SECTION 10	PAT	S10-PAT-01	500689.565	439770.0607	TRACK (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A		ID-00402
30/01/2023	SECTION 10	OUX	S10-OUX-05	500689.703	439769.2785	BT OPENREACH OVERHEAD TELECOM LINE (HAUL ROAD CROSSING)	OVERHEAD	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00403
30/01/2023	SECTION 10	UUX	S10-UUX-11	500689.952	439767.2333	KCOM GROUP TELECOM DUCT (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00404
30/01/2023	SECTION 10	UUX	S10-UUX-12	500690.222	439766.4764	KCOM GROUP TELECOM DUCT (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00405
30/01/2023	SECTION 10	EOX	S10-EOX-14	500690.604	439765.8928	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00406
30/01/2023	SECTION 10	UUX	S10-UUX-13	500690.938	439764.8932	NORTHERN GAS NETWORKS MEDIUM PRESSURE GAS MAIN (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00407
30/01/2023	SECTION 10	RX	S10-RX-04	500694.351	439752.9859	A1174 (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS OFF ROAD REQUIRED.	ID-00408
30/01/2023	SECTION 10	EOX	S10-EOX-15	500699.48	439733.15	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00409
30/01/2023	SECTION 16A	EOX	S16A-EOX-02	500783.13	439340.1535	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00141	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00410
30/01/2023	SECTION 16A	EOX	S16A-EOX-03	501194.512	438853.5879	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S16A-EOX-01	ID-00142	2	P	N/A	POTENTIAL 'LOCKOUT' FOR HAUL ROAD. HAUL ROAD CROSSING MAY BE POSSIBLE IF CABLES INSTALLED ACROSS ROAD VIA TRENCHING.	ID-00411
30/01/2023	SECTION 16A	RX	S16A-RX-01	501197.735	438850.2973	NEWBALD ROAD	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S16A-EOX-01, RHDHV T&T HAVE NOT IDENTIFIED ANY SIGNIFICANT ISSUES WITH TRENCHING OF ROAD. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE.	ID-00142	2	P	N/A	CURRENTLY CONSIDERED TO BE 'LOCKOUT' FOR HAUL ROAD CONTINUITY. NO HAUL ROAD CROSSING OF ROAD REQUIRED. IF CLEARANCE UNDERTAKEN FOR CABLE CROSSINGS THIS MAY ALLOW HAUL ROAD CROSSING OF ROAD.	ID-00412
30/01/2023	SECTION 16A	UUX	S16A-UUX-01	501200.327	438847.2688	KCOM GROUP TELECOM DUCT	BURIED	P	Y	P	P	NONE TO DATE	CROSSED WITH S16A-EOX-01	ID-00142	2	P	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00413
30/01/2023	SECTION 16A	UUX	S16A-UUX-02	501201.089	438846.6146	KCOM GROUP TELECOM DUCT- PROPOSED	BURIED	P	Y	P	P	NONE TO DATE	CROSSED WITH S16A-EOX-01	ID-00142	2	P	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00414
30/01/2023	SECTION 16A	EOX	S16A-EOX-01	501201.533	438845.9221	MATURE TREES ALONG NEWBALD ROAD	SURFACE	P	Y	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING MAY BE REQUIRED, SUITABILITY FOR HDD TO BE CONFIRMED AND OTHER TRENCHLESS TECHNIQUE MAY BE REQUIRED.	ID-00142	2	P	N/A	POTENTIAL 'LOCKOUT' FOR HAUL ROAD. HAUL ROAD CROSSING MAY BE POSSIBLE IF CABLES INSTALLED ACROSS ROAD VIA TRENCHING.	ID-00415
30/01/2023	SECTION 16B	WX	S16B-WX-01	501475.777	438652.3998	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00143	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00416
30/01/2023	SECTION 16B	EOX	S16B-EOX-01	501474.431	438653.7755	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S16B-WX-01	ID-00143	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00417
30/01/2023	SECTION 16B	PAT	S16B-PAT-01	501476.658	438651.1159	PROW - TRACK	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S16B-WX-01	ID-00143	1	Y	N/A		ID-00418
30/01/2023	SECTION 16B	EOX	S16B-EOX-02	501571.953	438555.6527	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00144	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00419
30/01/2023	SECTION 16B	UUX	S16B-UUX-03	501822.623	438117.9985	KCOM GROUP TELECOM DUCT	BURIED	P	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-01	ID-00145	3	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00420
30/01/2023	SECTION 16B	UUX	S16B-UUX-04	501822.757	438117.7616	KCOM GROUP TELECOM DUCT	BURIED	P	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-01	ID-00145	3	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00421
30/01/2023	SECTION 16B	EOX	S16B-EOX-03	501822.417	438118.3634	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-01	ID-00145	3	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00422
30/01/2023	SECTION 16B	UUX	S16B-UUX-05	501823.641	438116.1994	YORKSHIRE WATER- WATER MAIN - OVER 4 INCHES	BURIED	P	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-01	ID-00145	3	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00423
30/01/2023	SECTION 16B	RX	S16B-RX-01	501825.499	438112.9135	B1230 BROADGATE	SURFACE	P	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	LIKELY TO REQUIRE COMMITMENT TO TRENCHLESS CROSSING BASED ON RHDHV T&T RECOMMENDATION BUT OPTION FOR TRENCHING RETAINED DUE TO CONSTRAINTS TO SOUTH OF B1230. TRENCH CROSSING WOULD REQUIRE RETENTION OF SINGLE WORKING LANE TO MAINTAIN ACCESS.	ID-00145	3	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS AND CROSSING OF ROAD REQUIRED.	ID-00424
30/01/2023	SECTION 16B	UUX	S16B-UUX-01	501828.025	438108.447	NORTHERN GAS NETWORKS MEDIUM PRESSURE GAS MAIN	BURIED	P	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-01	ID-00145	3	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00425
30/01/2023	SECTION 16B	UUX	S16B-UUX-06	501828.355	438107.864	YORKSHIRE WATER- WATER MAIN -8 INCHES uPVC	BURIED	P	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-01	ID-00145	3	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00426
30/01/2023	SECTION 16B	EOX	S16B-EOX-04	501829.498	438105.843	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-01	ID-00145	3	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00427
30/01/2023	SECTION 16B	UUX	S16B-UUX-07	501846.047	438076.5808	YORKSHIRE WATER SEWERAGE - FOUL SEWER 225MM VC	BURIED	P	Y	P	P	NONE TO DATE	POTENTIALLY CROSSED WITH S16B-RX-01 OR CROSSED SEPARATELY	ID-00145	3	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00428
30/01/2023	SECTION 16B	EOX	S16B-EOX-05	501868.645	438085.7689	MATURE TREES SOUTH OF B1230 BROADGATE	SURFACE	P	Y	P	N	NONE TO DATE	POTENTIALLY CROSSED WITH S16B-RX-01 OR MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CABLE ROUTE ALIGNMENT	ID-00145	3	N	N/A	HAUL ROAD WOULD AVOID WOODLAND	ID-00429
30/01/2023	SECTION 16B	UUX	S16B-UUX-08	501897.875	438060.1235	KCOM GROUP TELECOM DUCT	BURIED	P	Y	P	P	NONE TO DATE	POTENTIALLY CROSSED WITH S16B-RX-01 OR CROSSED SEPARATELY, MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CABLE ROUTE ALIGNMENT	ID-00145	3	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00430
30/01/2023	SECTION 16B	EOX	S16B-EOX-06	501898.473	438058.2225	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	POTENTIALLY CROSSED WITH S16B-RX-01 OR CROSSED SEPARATELY, MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CABLE ROUTE ALIGNMENT	ID-00145	3	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00431
30/01/2023	SECTION 16B	PRX	S16B-PRX-01	501899.13	438055.1669	PRIVATE ROAD - ACCESS TO YORKSHIRE WATER COVERED RESERVOIRS	SURFACE	P	Y	P	P	NONE TO DATE	POTENTIALLY CROSSED WITH S16B-RX-01 OR CROSSED SEPARATELY, MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CABLE ROUTE ALIGNMENT. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00145	3	P	N/A	HAUL ROAD CROSSING OF ROAD POTENTIALLY REQUIRED.	ID-00432

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 16B	UUX	S16B-UUX-02	501900.105	438052.3155	NORTHERN GAS NETWORKS MEDIUM PRESSURE GAS MAIN	BURIED	P	Y	P	N	NONE TO DATE	POTENTIALLY CROSSED WITH S16B-RX-01 OR CROSSED SEPARATELY, MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CABLE ROUTE ALIGNMENT	ID-00145	3	P	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00433
30/01/2023	SECTION 16B	EOX	S16B-EOX-07	501841.176	438023.4807	MATURE TREES SOUTH OF B1230 BROADGATE	SURFACE	P	Y	P	N	NONE TO DATE	POTENTIALLY CROSSED WITH S16B-UUX-07 OR MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CABLE ROUTE ALIGNMENT	ID-00145	2	N	N/A	HAUL ROAD WOULD AVOID WOODLAND	ID-00434
30/01/2023	SECTION 16B	EOX	S16B-EOX-30	501727.43	438077.72	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00435
30/01/2023	SECTION 16B	UUX	S16B-UUX-24	501727.708	438076.8783	KCOM GROUP TELECOM DUCT (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00436
30/01/2023	SECTION 16B	UUX	S16B-UUX-25	501727.76	438076.6536	YORKSHIRE WATER- WATER MAIN (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00437
30/01/2023	SECTION 16B	UUX	S16B-UUX-26	501728.215	438074.6583	YORKSHIRE WATER- WATER MAIN (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00438
30/01/2023	SECTION 16B	RX	S16B-RX-06	501728.417	438074.0707	B1230 BROADGATE (HAUL ROAD ACCESS)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS OFF ROAD REQUIRED.	ID-00439
30/01/2023	SECTION 16B	OUX	S16B-OUX-01	501929.316	437875.6421	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	CROSSED WITH S16B-EOX-08	ID-00146	3	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00440
30/01/2023	SECTION 16B	OXX	S16B-OXX-01	501915.46	437857.0635	BUILDING - UNKNOWN USE / OWNERSHIP	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S16B-EOX-08, USAGE OF BUILDING SHOULD BE CONFIRMED. POTENTIALLY COULD BE AVOIDED WITHIN CABLE ROUTEING	ID-00146	3	N	N/A		ID-00441
30/01/2023	SECTION 16B	EOX	S16B-EOX-08	501938.495	437858.6549	LARGE HEDGEROW AND MATURE TREES	SURFACE	Y	P	P	N	NONE TO DATE	CROSSING OF HEDGEROW AT PINCH POINT AND COMMITMENT TO TRENCHING MAY BE REQUIRED DEPENDING ON CABLE SEPARATION REQUIREMENTS	ID-00146	3	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00442
30/01/2023	SECTION 16B	UUX	S16B-UUX-09	501940.501	437854.9428	YORKSHIRE WATER- WATER MAIN - UNDER 4 INCHES	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S16B-EOX-08	ID-00146	3	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00443
30/01/2023	SECTION 16B	UUX	S16B-UUX-10	501944.146	437791.9385	YORKSHIRE WATER- WATER MAIN - UNDER 4 INCHES	BURIED	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00147	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00444
30/01/2023	SECTION 16B	EOX	S16B-EOX-09	501938.067	437740.8186	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00148	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00445
30/01/2023	SECTION 16B	OUX	S16B-OUX-02	501888.388	437768.8736	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	CROSSED WITH S16B-EOX-09 OR MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CABLE ROUTEING	ID-00148	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00446
30/01/2023	SECTION 16B	OUX	S16B-OUX-03	501898.649	437689.2163	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00149	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00447
30/01/2023	SECTION 16B	OUX	S16B-OUX-04	501841.832	437517.7636	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00150	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00448
30/01/2023	SECTION 16B	OUX	S16B-OUX-05	501956.056	437471.5726	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00151	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00449
30/01/2023	SECTION 16B	EOX	S16B-EOX-10	501812.858	437400.189	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	POTENTIALLY CROSSED WITH S16B-RX-02 OR MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CABLE ROUTEING	ID-00152	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00450
30/01/2023	SECTION 16B	EOX	S16B-EOX-11	501710.481	437410.4974	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-02	ID-00152	2	N	N/A	HAUL ROAD CROSSING OF HEDGEROW NOT REQUIRED AS NO HAUL ROAD CONTINUITY ASSUMED ACROSS A1079	ID-00451
30/01/2023	SECTION 16B	RX	S16B-RX-02	501699.44	437397.4608	A1079	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00152	2	Y	N/A	SUBSTATION ACCESS FROM SOUTH OF ROAD. CURRENTLY CONSIDERED TO BE 'LOCKOUT' FOR HAUL ROAD CONTINUITY. NO HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00452
30/01/2023	SECTION 16B	EOX	S16B-EOX-12	501688.074	437384.7338	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-02	ID-00152	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00453
30/01/2023	SECTION 14	EOX	S14-EOX-02	501653.544	437385.5344	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	POTENTIALLY CROSSED WITH S16B-RX-02 OR MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CABLE ROUTEING	ID-00152	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00454
30/01/2023	SECTION 16B	OUX	S16B-OUX-06	502130.779	437450.4601	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED	ID-00153	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00455
30/01/2023	SECTION 16B	WX	S16B-WX-02	502238.948	437291.3837	POND	SURFACE	P	P	P	N	NONE TO DATE	POND WITHIN CABLE CORRIDOR, MAY BE AVOIDED DEPENDING ON FINAL CABLE ROUTE ALIGNMENT	ID-00154	1	N	N/A	HAUL ROAD WOULD AVOID POND	ID-00456
30/01/2023	SECTION 16B	EOX	S16B-EOX-13	502244.152	437293.8585	WOODLAND	SURFACE	P	P	P	N	NONE TO DATE	CROSSED WITH S16B-WX-02	ID-00154	1	N	N/A	HAUL ROAD WOULD AVOID WOODLAND	ID-00457
30/01/2023	SECTION 16B	UUX	S16B-UUX-11	502080.627	437319.4377	YORKSHIRE WATER- WATER MAIN - UNDER 4 INCHES	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S16B-EOX-14	ID-00155	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00458
30/01/2023	SECTION 16B	EOX	S16B-EOX-14	502076.731	437310.0118	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED. CROSSING MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CABLE ROUTEING	ID-00155	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00459
30/01/2023	SECTION 16B	UUX	S16B-UUX-12	502078.205	437200.8755	YORKSHIRE WATER- WATER MAIN - UNDER 4 INCHES	BURIED	P	P	P	P	NONE TO DATE	POTENTIALLY CROSSED WITH S16B-RX-03 OR AVOIDED DEPENDING ON FINAL CABLE ROUTE ALIGNMENT	ID-00156	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00460
30/01/2023	SECTION 16B	EOX	S16B-EOX-15	502113.887	437180.5416	HEDGEROW	SURFACE	N	P	P	N	NONE TO DATE	POTENTIALLY CROSSED WITH S16B-RX-03 OR AVOIDED DEPENDING ON FINAL CABLE ROUTE ALIGNMENT	ID-00157	3	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00461
30/01/2023	SECTION 16B	EOX	S16B-EOX-16	502175.924	437149.9088	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	2	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A1079 CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00462
30/01/2023	SECTION 16B	WX	S16B-WX-03	502175.825	437147.4324	WATERCOURSE / DRAIN	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	2	N	N/A	NO HAUL ROAD CROSSING OF WATERCOURSE REQUIRED AT THIS LOCATION.	ID-00463
30/01/2023	SECTION 16B	UUX	S16B-UUX-13	502175.611	437142.0506	SEWER 300MM VC	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	2	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00464
30/01/2023	SECTION 16B	PAT	S16B-PAT-02	502174.947	437125.3969	TRACK	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	2	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00465
30/01/2023	SECTION 16B	EOX	S16B-EOX-17	502174.89	437115.92	TREES	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	2	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A1079 CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00466
30/01/2023	SECTION 16B	EOX	S16B-EOX-18	502203.769	437108.5635	TREES	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	2	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A1079 CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00467
30/01/2023	SECTION 16B	UUX	S16B-UUX-14	502174.19	437106.4002	KCOM GROUP TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	2	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00468
30/01/2023	SECTION 16B	UUX	S16B-UUX-15	502173.864	437098.2079	KCOM GROUP TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	2	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00469
30/01/2023	SECTION 16B	EOX	S16B-EOX-19	502170.34	437099.38	HEDGEROW / TREES	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	2	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A1079 CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00470
30/01/2023	SECTION 16B	RX	S16B-RX-03	502173.323	437084.6256	A1079	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00157	2	N	N/A	CURRENTLY CONSIDERED TO BE 'LOCKOUT' FOR HAUL ROAD CONTINUITY. NO HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00471
30/01/2023	SECTION 16B	EOX	S16B-EOX-20	502172.76	437070.5006	HEDGEROW / TREES	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	2	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A1079 CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00472
30/01/2023	SECTION 16B	UUX	S16B-UUX-16	502173.996	437101.5238	KCOM GROUP TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	2	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00473

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 16B	PRX	S16B-PRX-02	502173.712	437094.3922	PRIVATE ROAD - ACCESS TO BUTT FARM AND PROW	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-03. TRENCHLESS CROSSING WOULD LIKELY NEED TO AVOID DRILLING DIRECTLY BENEATH OR IN PROXIMITY TO BRIDGE ACROSS A1079	ID-00157	3	N	N/A	NO HAUL ROAD CROSSING OF ROAD AT THIS LOCATION.	ID-00474
30/01/2023	SECTION 14	UUX	S14-UUX-02	502116.016	437079.7908	KCOM GROUP TELECOM	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00475
30/01/2023	SECTION 14	EOX	S14-EOX-03	502135.153	437072.9656	TREES	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A1079 CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00476
30/01/2023	SECTION 14	EOX	S14-EOX-04	502142.338	437057.6272	TREES	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A1079 CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00477
30/01/2023	SECTION 14	OUX	S14-OUX-01	502170.479	437013.2614	NATIONAL GRID ELECTRICITY TRANSMISSION LINE - 400kV	OVERHEAD	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-03.	ID-00157	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00478
30/01/2023	SECTION 16B	EOX	S16B-EOX-21	502283.838	437170.7504	HEDGEROW	SURFACE	Y	N	P	N	NONE TO DATE	CROSSED WITH S16B-WX-04.	ID-00158	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00479
30/01/2023	SECTION 16B	WX	S16B-WX-04	502284.115	437168.9735	WATERCOURSE / DRAIN	SURFACE	Y	N	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED. POTENTIALLY COMBINED WITH CROSSING OF S16b-PRX-02	ID-00158	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00480
30/01/2023	SECTION 16B	UUX	S16B-UUX-17	502285.032	437163.3817	YORKSHIRE WATER SEWERAGE - COMBINED SEWER 300MM VC	BURIED	Y	N	P	P	NONE TO DATE	CROSSED WITH S16B-WX-04.	ID-00158	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00481
30/01/2023	SECTION 16B	PAT	S16B-PAT-03	502283.97	437129.3528	TRACK	SURFACE	Y	N	P	P	NONE TO DATE	CROSSED WITH S16B-PRX-03.	ID-00159	1	Y	N/A		ID-00482
30/01/2023	SECTION 16B	EOX	S16B-EOX-22	502284.807	437122.8408	TREES	SURFACE	Y	N	P	N	NONE TO DATE	CROSSED WITH S16B-PRX-03.	ID-00159	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00483
30/01/2023	SECTION 16B	UUX	S16B-UUX-18	502284.298	437118.584	KCOM GROUP TELECOM DUCT	BURIED	Y	N	P	P	NONE TO DATE	CROSSED WITH S16B-PRX-03.	ID-00159	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00484
30/01/2023	SECTION 16B	PRX	S16B-PRX-03	502284.224	437116.7504	PRIVATE ROAD - ACCESS TO BUTT FARM AND PROW	SURFACE	Y	N	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00159	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00485
30/01/2023	SECTION 16B	EOX	S16B-EOX-23	502259.088	437115.7382	TREES	SURFACE	Y	N	P	N	NONE TO DATE	CROSSED WITH S16B-PRX-03.	ID-00159	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00486
30/01/2023	SECTION 16B	EOX	S16B-EOX-24	502339.614	437123.8647	HEDGEROW	SURFACE	Y	N	P	N	NONE TO DATE	CROSSED WITH S16B-PRX-03.	ID-00159	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00487
30/01/2023	SECTION 16B	EOX	S16B-EOX-25	502422.251	437086.4921	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00160	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00488
30/01/2023	SECTION 16B	EOX	S16B-EOX-26	502499.617	437072.034	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S16B-RX-05	ID-00161	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00489
30/01/2023	SECTION 16B	UUX	S16B-UUX-19	502501.626	437072.2014	YORKSHIRE WATER- WATER MAIN - OVER 4 INCHES	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S16B-RX-05	ID-00161	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00490
30/01/2023	SECTION 16B	RX	S16B-RX-05	502508.241	437072.7816	VICTORIA ROAD - ACCESS TO JOCKS LODGE FARM	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00161	2	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00491
30/01/2023	SECTION 16B	UUX	S16B-UUX-20	502512.284	437072.8446	KCOM GROUP TELECOM DUCT	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S16B-RX-05	ID-00161	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00492
30/01/2023	SECTION 16B	UUX	S16B-UUX-21	502513.559	437072.8084	KCOM GROUP TELECOM DUCT	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S16B-RX-05	ID-00161	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00493
30/01/2023	SECTION 16B	EOX	S16B-EOX-27	502519.212	437072.835	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S16B-RX-05	ID-00161	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00494
30/01/2023	SECTION 16B	EOX	S16B-EOX-28	502647.207	437054.9323	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-04	ID-00162	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A164 AND NEW ROAD ASSOCIATED WITH JOCKS LODGE UPGRADE WORKS CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00495
30/01/2023	SECTION 16B	UUX	S16B-UUX-22	502647.803	437054.8653	YORKSHIRE WATER- WATER MAIN - UNDER 4 INCHES	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-04	ID-00162	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00496
30/01/2023	SECTION 16B	UUX	S16B-UUX-23	502649.289	437054.6977	KCOM GROUP TELECOM DUCT - PROPOSED	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-04	ID-00162	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00497
30/01/2023	SECTION 16B	RX	S16B-RX-04	502656.193	437053.9198	A164	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00162	3	N	N/A	CURRENTLY CONSIDERED TO BE 'LOCKOUT' FOR HAUL ROAD CONTINUITY. NO HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00498
30/01/2023	SECTION 16B	UUX	S16B-UUX-23	502667.064	437052.6949	KCOM GROUP TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-04	ID-00162	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00499
30/01/2023	SECTION 16B	EOX	S16B-EOX-29	502670.61	437052.2952	HEDGEROW AND MATURE TREES	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-04	ID-00162	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A164 AND NEW ROAD ASSOCIATED WITH JOCKS LODGE UPGRADE WORKS CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00500
30/01/2023	SECTION 17	EOX	S17-EOX-01	502798.893	436938.4416	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-04	ID-00162	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A164 AND NEW ROAD ASSOCIATED WITH JOCKS LODGE UPGRADE WORKS CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00501
30/01/2023	SECTION 17	RX	S17-RX-01	502808.807	436937.5593	SLIP ROAD FROM A164 TO A1079	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	CROSSED IN SAME CROSSING AS S16-RX-04 OR SLIP ROAD MAY BE REMOVED AS PART OF JOCKS LODGE ROAD UPGRADE WORKS	ID-00162	3	N	N/A	CURRENTLY CONSIDERED TO BE 'LOCKOUT' FOR HAUL ROAD CONTINUITY. NO HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00502
30/01/2023	SECTION 17	EOX	S17-EOX-02	502819.563	436936.8713	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-04	ID-00162	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A164 AND NEW ROAD ASSOCIATED WITH JOCKS LODGE UPGRADE WORKS CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00503
30/01/2023	SECTION 17	OUX	S17-OUX-03	502893.281	437027.204	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	N	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-04	ID-00162	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00504
30/01/2023	SECTION 17	WX	S17-WX-01	502893.493	437027.1801	WATERCOURSE / DRAIN	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S16B-RX-04	ID-00162	3	N	N/A	NO HAUL ROAD CROSSING OF WATERCOURSE REQUIRED AT THIS LOCATION.	ID-00505
30/01/2023	SECTION 17	EOX	S17-EOX-03	502894.589	437027.0566	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-04	ID-00162	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A164 AND NEW ROAD ASSOCIATED WITH JOCKS LODGE UPGRADE WORKS CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00506
30/01/2023	SECTION 17	PAT	S17-PAT-01	502898.556	437026.6096	TRACK	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-04	ID-00162	3	N	N/A		ID-00507
30/01/2023	SECTION 17	RX	S17-RX-03	502906.856	437025.6743	PROPOSED NEW ROAD AS PART OF JOCKS LODGE UPGRADE WORKS	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S16B-RX-04	ID-00162	3	N	N/A	CURRENTLY CONSIDERED TO BE 'LOCKOUT' FOR HAUL ROAD CONTINUITY. NO HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00508
30/01/2023	SECTION 14	OUX	S14-OUX-02	501557.392	437293.7909	NATIONAL GRID ELECTRICITY TRANSMISSION LINE - 400kV	OVERHEAD	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00163	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00509
30/01/2023	SECTION 14	EOX	S14-EOX-19	501488.25	437171.107	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00510
30/01/2023	SECTION 14	UUX	S14-UUX-03	501542.938	437136.4544	YORKSHIRE WATER SEWERAGE - COMBINED SEWER 300MM VC	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S14-WX-01	ID-00164	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00511
30/01/2023	SECTION 14	WX	S14-WX-01	501541.59	437123.55	AUTHERD DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00164	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00512
30/01/2023	SECTION 14	OUX	S14-OUX-03	501531.844	437041.9356	NORTHERN POWERGRID HIGH VOLTAGE 33kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00165	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00513
30/01/2023	SECTION 14	EOX	S14-EOX-05	501537.352	436987.6933	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00166	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00514

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 14	EOX	S14-EOX-06	501607.432	436803.3785	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00167	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00515
30/01/2023	SECTION 14	WX	S14-WX-02	501834.96	436593.2722	WATERCOURSE / DRAIN	SURFACE	P	P	P	P	NONE TO DATE	WATERCOURSE WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF WATERCOURSE TBC. WATERCOURSE DIVERSION MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00168	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00516
30/01/2023	SECTION 14	WX	S14-WX-03	501949.8	436541.5597	WATERCOURSE / DRAIN	SURFACE	P	P	P	P	NONE TO DATE	WATERCOURSE WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF WATERCOURSE TBC. WATERCOURSE DIVERSION MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00169	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00517
30/01/2023	SECTION 14	EOX	S14-EOX-07	501952.159	436541.3886	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	HEDGEROW WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF HEDGEROW TBC, CROSSED WITH S14-WX-03. HEDGEROW REMOVAL MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00169	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00518
30/01/2023	SECTION 14	WX	S14-WX-04	502042.99	436571.54	WATERCOURSE / DRAIN	SURFACE	P	P	P	P	NONE TO DATE	WATERCOURSE WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF WATERCOURSE TBC. WATERCOURSE DIVERSION MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00170	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00519
30/01/2023	SECTION 14	EOX	S14-EOX-08	502045.481	436572.4912	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	HEDGEROW WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF HEDGEROW TBC, CROSSED WITH S14-WX-04. HEDGEROW REMOVAL MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00171	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00520
30/01/2023	SECTION 14	OUX	S14-OUX-04	502122.662	436898.6573	NORTHERN POWERGRID HIGH VOLTAGE 33KV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00172	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00521
30/01/2023	SECTION 14	WX	S14-WX-05	502114.73	436868.64	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00173	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00522
30/01/2023	SECTION 14	EOX	S14-EOX-09	502114.93	436867.4822	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S14-WX-05	ID-00173	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00523
30/01/2023	SECTION 14	UUX	S14-UUX-04	502110.709	436821.0002	YORKSHIRE WATER- WATER MAIN - UNDER 4 INCHES	BURIED	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00174	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00524
30/01/2023	SECTION 14	UUX	S14-UUX-01	502143.831	436658.8129	YORKSHIRE WATER- WATER MAIN - UNDER 4 INCHES	BURIED	P	P	P	P	NONE TO DATE	WATER MAIN MAY REQUIRE DIVERSION OF SUBSTATION PERMANENT FOOTPRINT AND DRAINAGE INFRASTRUCTURE. REQUIREMENT FOR DIVERSION AND PROPOSED DIVERSION ROUTE TBC AND WOULD REQUIRE DISCUSSION WITH ASSET OWNER.	ID-00175	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00525
30/01/2023	SECTION 14	EOX	S14-EOX-01	502176.729	436802.852	ANCIENT WOODLAND	SURFACE	N	Y	P	N	NONE TO DATE	TRENCHLESS CROSSING OF ANCIENT WOODLAND REQUIRED IF UNABLE TO AVOID WITHIN CABLE ROUTEING	ID-00176	2	N	N/A	HAUL ROAD WOULD AVOID WOODLAND	ID-00526
30/01/2023	SECTION 14	WX	S14-WX-06	502231.66	436940.17	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00177	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00527
30/01/2023	SECTION 14	OUX	S14-OUX-05	502236.186	436933.4168	NORTHERN POWERGRID HIGH VOLTAGE 33KV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	N	NONE TO DATE	CROSSED WITH S14-WX-06	ID-00177	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00528
30/01/2023	SECTION 14	EOX	S14-EOX-10	502201.402	436615.1123	ANCIENT WOODLAND	SURFACE	N	Y	P	N	NONE TO DATE	TRENCHLESS CROSSING OF ANCIENT WOODLAND REQUIRED IF UNABLE TO AVOID WITHIN CABLE ROUTEING	ID-00178	2	N	N/A	HAUL ROAD WOULD AVOID WOODLAND	ID-00529
30/01/2023	SECTION 14	WX	S14-WX-07	502230.429	436609.1994	WATERCOURSE / DRAIN	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S14-EOX-10 OR S14-EOX-11	ID-00178	2	N	N/A	NO HAUL ROAD CROSSING OF WATERCOURSE REQUIRED AT THIS LOCATION.	ID-00530
30/01/2023	SECTION 14	EOX	S14-EOX-11	502289.35	436685.3524	WOODLAND BLOCK	SURFACE	N	Y	P	N	NONE TO DATE	TRENCHLESS CROSSING OF WOODLAND REQUIRED IF UNABLE TO AVOID WITHIN CABLE ROUTEING	ID-00179	2	N	N/A	HAUL ROAD WOULD AVOID WOODLAND	ID-00531
30/01/2023	SECTION 14	WX	S14-WX-08	502379.4	436762.77	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00180	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00532
30/01/2023	SECTION 14	EOX	S14-EOX-12	502380.059	436761.4217	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S14-WX-08	ID-00180	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00533
30/01/2023	SECTION 14	EOX	S14-EOX-13	502428.1	436675.86	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S14-WX-09	ID-00181	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00534
30/01/2023	SECTION 14	WX	S14-WX-09	502428.4	436674.37	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00181	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00535
30/01/2023	SECTION 14	UUX	S14-UUX-05	502208.08	436445.8941	YORKSHIRE WATER- WATER MAIN - UNDER 4 INCHES	BURIED	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00182	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00536
30/01/2023	SECTION 14	WX	S14-WX-10	502273.205	436518.357	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S14-WX-11	ID-00183	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00537
30/01/2023	SECTION 14	WX	S14-WX-11	502274.203	436523.3732	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00183	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00538
30/01/2023	SECTION 14	EOX	S14-EOX-14	502274.861	436526.1594	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S14-WX-11	ID-00183	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00539
30/01/2023	SECTION 14	EOX	S14-EOX-15	502440.188	436567.682	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00184	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00540
30/01/2023	SECTION 14	EOX	S14-EOX-16	502528.614	436559.9307	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	LIKELY CROSSED WITH S14-RX-01 BUT MAY BE ABLE TO BE CROSSED SEPARATELY BY TRENCHING	ID-00185	3	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00541
30/01/2023	SECTION 14	OUX	S14-OUX-06	502531.515	436559.0551	NORTHERN POWERGRID LOW VOLTAGE OVERHEAD POWER LINE	OVERHEAD	P	Y	P	P	NONE TO DATE	LIKELY CROSSED WITH S14-RX-01 BUT MAY BE ABLE TO BE CROSSED SEPARATELY BY TRENCHING	ID-00185	3	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00542
30/01/2023	SECTION 14	EOX	S14-EOX-17	502582.585	436586.1875	HEDGEROW / TREES	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S14-RX-01	ID-00185	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A164 AND NEW ROAD ASSOCIATED WITH JOCKS LODGE UPGRADE WORKS CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00543
30/01/2023	SECTION 14	UUX	S14-UUX-06	502579.429	436553.4694	KCOM GROUP TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S14-RX-01	ID-00185	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00544
30/01/2023	SECTION 14	UUX	S14-UUX-07	502580.224	436553.364	KCOM GROUP TELECOM DUCT PROPOSED	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S14-RX-01	ID-00185	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00545
30/01/2023	SECTION 14	RX	S14-RX-01	502586.147	436552.3957	A164	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00185	3	N	N/A	CURRENTLY CONSIDERED TO BE 'LOCKOUT' FOR HAUL ROAD CONTINUITY. NO HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00546
30/01/2023	SECTION 14	UUX	S14-UUX-08	502594.331	436551.041	KCOM GROUP TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S14-RX-01	ID-00185	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00547
30/01/2023	SECTION 14	UUX	S14-UUX-09	502594.881	436550.9897	YORKSHIRE WATER- WATER MAIN - UNDER 4 INCHES	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S14-RX-01	ID-00185	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00548
30/01/2023	SECTION 14	UUX	S14-UUX-10	502595.263	436550.9199	KCOM GROUP TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S14-RX-01	ID-00185	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00549
30/01/2023	SECTION 14	EOX	S14-EOX-18	502602.067	436549.6037	HEDGEROW / TREES	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S14-RX-01	ID-00185	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A164 AND NEW ROAD ASSOCIATED WITH JOCKS LODGE UPGRADE WORKS CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00550
30/01/2023	SECTION 15	PAT	S15-PAT-01	502613.58	436579.3859	TRACK	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S14-RX-01	ID-00185	3	N	N/A	NO HAUL ROAD CROSSING OF WATERCOURSE REQUIRED AT THIS LOCATION.	ID-00551
30/01/2023	SECTION 15	WX	S15-WX-01	502654.684	436584.9636	WATERCOURSE / DRAIN	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S14-RX-01	ID-00185	3	N	N/A	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED AT THIS LOCATION.	ID-00552
30/01/2023	SECTION 15	RX	S15-RX-02	502610.803	436548.4477	PROPOSED ROAD A PART OF JOCKS LODGE UPGRADE WORKS	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S14-RX-01	ID-00185	3	N	N/A	CURRENTLY CONSIDERED TO BE 'LOCKOUT' FOR HAUL ROAD CONTINUITY. NO HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00553
30/01/2023	SECTION 15	RX	S15-RX-03	502697.378	436533.3509	PROPOSED ROAD A PART OF JOCKS LODGE UPGRADE WORKS	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S14-RX-01	ID-00185	3	N	N/A	CURRENTLY CONSIDERED TO BE 'LOCKOUT' FOR HAUL ROAD CONTINUITY. NO HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00554
30/01/2023	SECTION 15	RX	S15-RX-04	502725.072	436528.6112	PROPOSED ROAD A PART OF JOCKS LODGE UPGRADE WORKS	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S14-RX-01	ID-00185	3	N	N/A	CURRENTLY CONSIDERED TO BE 'LOCKOUT' FOR HAUL ROAD CONTINUITY. NO HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00555

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 17	UUX	S17-UUX-01	503199.146	437027.2518	NATIONAL GRID HIGH PRESSURE GAS MAIN	BURIED	P	Y	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY REQUIRED	ID-00186	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00556
30/01/2023	SECTION 17	EOX	S17-EOX-04	503246.36	437014.57	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	MAY BE CROSSED WITH S17-UUX-01 IF OBSTACLE CROSSED VIA HDD, ALTERNATIVELY SEPARATE CROSSING AND TRENCHED	ID-00187	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00557
30/01/2023	SECTION 17	OUX	S17-OUX-01	503443.842	436974.5702	NORTHERN POWER GRID 33kV ELECTRICITY LINE	OVERHEAD	P	P	P	P	NONE TO DATE	OVERHEAD POWERLINE WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF OVERHEAD LINE TBC. OVERHEAD LINE DIVERSION MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00188	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00558
30/01/2023	SECTION 17	EOX	S17-EOX-05	503522.109	436920.9799	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	HEDGEROW WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF HEDGEROW TBC. HEDGEROW REMOVAL MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00189	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00559
30/01/2023	SECTION 17	OUX	S17-OUX-02	503642.07	436805.54	NORTHERN POWER GRID 33kV ELECTRICITY LINE	OVERHEAD	P	P	P	P	NONE TO DATE	OVERHEAD POWERLINE WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF OVERHEAD LINE TBC. OVERHEAD LINE DIVERSION MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00190	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00560
30/01/2023	SECTION 17	EOX	S17-EOX-06	503284.225	436851.377	WOODLAND	SURFACE	P	P	P	N	NONE TO DATE	WOODLAND WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF WOODLAND TBC. WOODLAND REMOVAL MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00191	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00561
30/01/2023	SECTION 17	EOX	S17-EOX-07	503282.95	436893.08	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	HEDGEROW WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF HEDGEROW TBC, CROSSED WITH S17-WX-02. HEDGEROW REMOVAL MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00192	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00562
30/01/2023	SECTION 17	WX	S17-WX-02	503280.76	436893.16	WATERCOURSE / DRAIN	SURFACE	P	P	P	P	NONE TO DATE	WATERCOURSE WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF WATERCOURSE TBC. WATERCOURSE DIVERSION MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00192	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00563
30/01/2023	SECTION 17	EOX	S17-EOX-08	503243.66	436828.7171	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	HEDGEROW WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF HEDGEROW TBC. HEDGEROW REMOVAL MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00193	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00564
30/01/2023	SECTION 17	WX	S17-WX-03	503243.353	436910.2147	WATERCOURSE / DRAIN	SURFACE	P	P	P	P	NONE TO DATE	WATERCOURSE WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF WATERCOURSE TBC. WATERCOURSE DIVERSION MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00194	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00565
30/01/2023	SECTION 17	EOX	S17-EOX-09	503243.217	436911.7074	HEDGEROW	SURFACE	P	P	P	N	NONE TO DATE	HEDGEROW WITHIN INDICATIVE SUBSTATION FOOTPRINT LOCATION. REQUIREMENT FOR CROSSING OF HEDGEROW TBC, CROSSED WITH S17-WX-03. HEDGEROW REMOVAL MAY BE REQUIRED FOR SUBSTATION CONSTRUCTION	ID-00194	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00566
30/01/2023	SECTION 17	OUX	S17-OUX-04	503074.98	436908.6457	NORTHERN POWER GRID 33kV ELECTRICITY LINE	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED. REQUIREMENT FOR CROSSING TBC	ID-00195	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00567
30/01/2023	SECTION 17	EOX	S17-EOX-10	503131.668	436660.7758	HEDGEROW	SURFACE	P	Y	P	N	NONE TO DATE	CROSSED WITH S17-UUX-02	ID-00196	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00568
30/01/2023	SECTION 17	UUX	S17-UUX-02	503106.568	436673.3786	NATIONAL GRID HIGH PRESSURE GAS MAIN	SURFACE	P	Y	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY REQUIRED	ID-00196	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00569
30/01/2023	SECTION 17	RX	S17-RX-04	502905.649	436712.273	A1079 (HAUL ROAD CROSSING VIA BRIDGE)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	SUITABILITY OF EXISTING BRIDGE TBC.	ID-00570
30/01/2023	SECTION 15	OUX	S15-OUX-12	502894.023	436661.0582	NATIONAL GRID ELECTRICITY TRANSMISSION LINE - 400kV (HAUL ROAD CROSSING)	OVERHEAD	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00571
30/01/2023	SECTION 17	EOX	S17-EOX-11	502992.856	436685.6766	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S17-RX-02	ID-00197	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A1079 CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00572
30/01/2023	SECTION 17	RX	S17-RX-02	502983.531	436663.769	A1079	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00197	3	N	N/A	HAUL ROAD CROSSING OF ROAD MAY BE ABLE TO BE ACHIEVED USING BRIDGE TO WEST	ID-00573
30/01/2023	SECTION 15	UUX	S15-UUX-06	502977.739	436650.1624	KCOM GROUP TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S17-RX-02	ID-00197	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00574
30/01/2023	SECTION 15	EOX	S15-EOX-01	502976.867	436648.1151	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S17-RX-02	ID-00197	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A1079 CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00575
30/01/2023	SECTION 17	EOX	S17-EOX-12	503464.84	436602.49	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S17-OOX-01 AND / OR S15-RX-01	ID-00198	3	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00576
30/01/2023	SECTION 17	OUX	S17-OUX-05	503459.634	436566.0048	NORTHERN POWER GRID 33kV ELECTRICITY LINE	OVERHEAD	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S17-OOX-01 AND / OR S15-RX-01	ID-00198	3	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00577
30/01/2023	SECTION 17	OOX	S17-OOX-01	503461.282	436496.8212	PROPOSED SOLAR FARM	SURFACE	P	P	P	N	NONE TO DATE	METHODOLOGY FOR CROSSING OF PROPOSED SOLAR FARM TBC, REQUIREMENT FOR CROSSING TBC. MAY BE CROSSED WITH S15-RX-01	ID-00198	3	Y	N/A		ID-00578
30/01/2023	SECTION 17	EOX	S17-EOX-13	503572.43	436406.78	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S17-OOX-01 AND / OR S15-RX-01	ID-00198	3	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00579
30/01/2023	SECTION 17	WX	S17-WX-04	503457.58	436402.3	WATERCOURSE / DRAIN	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S15-RX-01. REQUIREMENT FOR CROSSING MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CROSSING ALIGNMENT	ID-00198	3	N	N/A	NO HAUL ROAD CROSSING OF WATERCOURSE REQUIRED AT THIS LOCATION.	ID-00580
30/01/2023	SECTION 17	EOX	S17-EOX-14	503454.388	436345.276	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S15-RX-01	ID-00198	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A1079 CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00581
30/01/2023	SECTION 17	RX	S17-RX-05	503568.308	437531.9535	A164 (HAUL ROAD ACCESS)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	ALLOWANCE FOR HAUL ROAD ACCESS OFF ROAD REQUIRED.	ID-00582
30/01/2023	SECTION 17	UUX	S17-UUX-03	503567.393	437528.7672	KCOM GROUP TELECOM DUCT (PROPOSED) (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00583
30/01/2023	SECTION 17	PAT	S17-PAT-02	503567.25	437485.2	TRACK - SHEPHERDS LANE (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A		ID-00584
30/01/2023	SECTION 17	WX	S17-WX-05	503567.03	437478.12	WATERCOURSE / DRAIN (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00585
30/01/2023	SECTION 17	UUX	S17-UUX-04	503503.333	437336.0065	NATIONAL GRID HIGH PRESSURE GAS MAIN (HAUL ROAD CROSSING)	BURIED	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00586
30/01/2023	SECTION 17	WX	S17-WX-06	503440.431	437204.0312	WATERCOURSE / DRAIN (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00587
30/01/2023	SECTION 17	OUX	S17-OUX-06	503440.033	437138.2417	NORTHERN POWER GRID 33kV ELECTRICITY LINE (HAUL ROAD CROSSING)	OVERHEAD	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00588
30/01/2023	SECTION 17	EOX	S17-EOX-15	503439.54	437125.72	HEDGEROW (HAUL ROAD CROSSING)	SURFACE	N/A	N/A	N/A	N	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00589
30/01/2023	SECTION 17	WX	S17-WX-07	503439.71	437124.2	WATERCOURSE / DRAIN (HAUL ROAD CROSSING)		N/A	N/A	N/A	P	NONE TO DATE	NOT CROSSED WITH CABLE ROUTE, HAUL ROAD CROSSING ONLY	N/A	N/A	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00590
30/01/2023	SECTION 15	RX	S15-RX-01	503454.742	436325.1396	A1079	SURFACE	N	Y	P	N	LOCAL AUTHORITY HAVE INDICATED PREFERENCE FOR ALL A AND B ROADS TO BE CROSSED VIA TRENCHLESS TECHNIQUES	COMMITMENT TO TRENCHLESS CROSSING MADE BASED ON RHDHV T&T RECOMMENDATION	ID-00198	3	N	N/A	CURRENTLY CONSIDERED TO BE 'LOCKOUT' FOR HAUL ROAD CONTINUITY. NO HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00591

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER

30/01/2023	SECTION 15	EOX	S15-EOX-02	503455.296	436308.1248	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S15-RX-01	ID-00198	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A1079 CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00592
30/01/2023	SECTION 15	PRX	S15-PRX-01	503453.718	436287.0056	PROPOSED PERMANENT SUBSTATION ACCESS FOR HORNSEA PROJECT 4	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S15-RX-01. REQUIREMENT FOR CROSSING MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CROSSING ALIGNMENT	ID-00198	3	N	N/A	NO HAUL ROAD CROSSING OF ROAD AT THIS LOCATION.	ID-00593
30/01/2023	SECTION 15	UUX	S15-UUX-07	503172.484	436507.9564	KCOM GROUP TELECOM DUCT	BURIED	N	Y	P	P	NONE TO DATE	CROSSED WITH S15-RX-01. REQUIREMENT FOR CROSSING MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CROSSING ALIGNMENT	ID-00198	3	N	N/A	NO HAUL ROAD CROSSING REQUIRED	ID-00594
30/01/2023	SECTION 15	RX	S15-RX-05	503240.506	436442.4575	PROPOSED ROAD A PART OF JOCKS LODGE UPGRADE WORKS	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S15-RX-01. REQUIREMENT FOR CROSSING MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CROSSING ALIGNMENT	ID-00198	3	N	N/A	NO HAUL ROAD CROSSING OF ROAD AT THIS LOCATION.	ID-00595
30/01/2023	SECTION 15	EOX	S15-EOX-03	503241.34	436419.7035	HEDGEROW	SURFACE	N	Y	P	N	NONE TO DATE	CROSSED WITH S15-RX-01. REQUIREMENT FOR CROSSING MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CROSSING ALIGNMENT	ID-00198	3	N	N/A	HAUL ROAD CROSSING NOT REQUIRED AS A1079 CONSIDERED 'LOCKOUT' FOR HAUL ROAD	ID-00596
30/01/2023	SECTION 15	WX	S15-WX-02	503241.19	436418.49	WATERCOURSE / DRAIN	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S15-RX-01. REQUIREMENT FOR CROSSING MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CROSSING ALIGNMENT	ID-00198	3	N	N/A	NO HAUL ROAD CROSSING OF WATERCOURSE REQUIRED AT THIS LOCATION.	ID-00597
30/01/2023	SECTION 15	PAT	S15-PAT-02	503241.012	436415.9358	PROW FOOTPATH	SURFACE	N	Y	P	P	NONE TO DATE	CROSSED WITH S15-RX-01. REQUIREMENT FOR CROSSING MAY BE ABLE TO BE AVOIDED DEPENDING ON FINAL CROSSING ALIGNMENT	ID-00198	3	N	N/A		ID-00598
30/01/2023	SECTION 15	OUX	S15-OUX-01	502958.26	436590.9575	NATIONAL GRID ELECTRICITY TRANSMISSION LINE - 400kV	OVERHEAD	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00199	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00599
30/01/2023	SECTION 15	OUX	S15-OUX-02	502852.001	436498.056	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00200	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00600
30/01/2023	SECTION 15	UUX	S15-UUX-01	502927.626	436460.4324	NATIONAL GRID HIGH PRESSURE GAS MAIN	BURIED	P	Y	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY REQUIRED	ID-00201	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00601
30/01/2023	SECTION 15	RX	S15-RX-06	503021.172	436380.4955	PROPOSED ROAD A PART OF JOCKS LODGE UPGRADE WORKS	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED. MAY BE ABLE TO BE COMBINED WITH CROSSING OF S15-UUX-01. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00202	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00602
30/01/2023	SECTION 15	PAT	S15-PAT-03	503022.509	436378.4368	PROW TRACK	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S15-RX-06	ID-00202	1	Y	N/A		ID-00603
30/01/2023	SECTION 15	WX	S15-WX-03	503024.51	436373.7	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S15-RX-06	ID-00202	1	Y		HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00604
30/01/2023	SECTION 15	EOX	S15-EOX-04	503025.481	436372.3578	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S15-RX-06	ID-00202	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00605
30/01/2023	SECTION 15	UUX	S15-UUX-02	503114.215	436304.1297	SABIC / INEOS HIGH PRESSURE ETHYLENE PIPELINE	BURIED	P	Y	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY REQUIRED	ID-00203	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00606
30/01/2023	SECTION 15	OUX	S15-OUX-03	503218.443	436190.5733	NORTHERN POWER GRID 33kV ELECTRICITY LINE	OVERHEAD	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00204	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00607
30/01/2023	SECTION 15	OUX	S15-OUX-04	503212.681	436314.801	NATIONAL GRID ELECTRICITY TRANSMISSION LINE - 400kV	OVERHEAD	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00205	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00608
30/01/2023	SECTION 15	OUX	S15-OUX-05	503281.304	436299.2353	NORTHERN POWER GRID 33kV ELECTRICITY LINE	OVERHEAD	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00206	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00609
30/01/2023	SECTION 15	UUX	S15-UUX-03	503455.384	436168.0105	SABIC / INEOS HIGH PRESSURE ETHYLENE PIPELINE	BURIED	P	Y	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY REQUIRED. MAY BE CROSSED IN SAME CROSSING AS S15-RX-01.	ID-00207	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00610
30/01/2023	SECTION 15	OUX	S15-OUX-06	503446.089	436062.7547	NATIONAL GRID ELECTRICITY TRANSMISSION LINE - 400kV	OVERHEAD	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED. MAY BE CROSSED WITH S15-UUX-03	ID-00208	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00611
30/01/2023	SECTION 15	WX	S15-WX-04	503428.54	435973	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00209	1	Y		HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00612
30/01/2023	SECTION 15	OUX	S15-OUX-07	503451.588	435798.3962	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S15-OOX-01 AND / OR S15-PRX-03	ID-00210	3	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00613
30/01/2023	SECTION 15	OUX	S15-OUX-08	503453.994	435791.0669	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S15-OOX-01 AND / OR S15-PRX-03	ID-00210	3	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00614
30/01/2023	SECTION 15	PRX	S15-PRX-03	503464.568	435755.126	PROPOSED PERMANENT SUBSTATION ACCESS FOR HORNSEA PROJECT 4	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S15-OOX-01. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00210	3	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00615
30/01/2023	SECTION 15	OOX	S15-OOX-01	503481.598	435667.1349	PROPOSED CREYKE BECK SOLAR FARM	SURFACE	P	P	P	N	NONE TO DATE ON NEW PROPOSED ROUTE.	METHODOLOGY FOR CROSSING OF PROPOSED SOLAR FARM TBC, REQUIREMENT FOR CROSSING TBC.	ID-00210	3	Y	N/A		ID-00616
30/01/2023	SECTION 15	OUX	S15-OUX-09	503579.777	435544.2421	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	CROSSED WITH S15-WX-05	ID-00210	3	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00617
30/01/2023	SECTION 15	OUX	S15-OUX-10	503605.321	435543.3493	NORTHERN POWERGRID HIGH VOLTAGE 11kV OVERHEAD POWER LINE	OVERHEAD	Y	P	P	P	NONE TO DATE	CROSSED WITH S15-WX-05	ID-00210	3	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00618
30/01/2023	SECTION 15	WX	S15-WX-05	503612.586	435542.4797	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00210	3	Y		HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00619
30/01/2023	SECTION 15	EOX	S15-EOX-05	503614.21	435542.39	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S15-WX-05	ID-00210	3	Y	N/A	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00620
30/01/2023	SECTION 15	PAT	S15-PAT-04	503620.583	435542.0552	PROW TRACK	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S15-WX-05	ID-00210	3	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00621
30/01/2023	SECTION 15	WX	S15-WX-06	503523.41	436025.37	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S15-OOX-02 AND / OR S15-PRX-02	ID-00211	2	Y		HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00622
30/01/2023	SECTION 15	PRX	S15-PRX-02	503553.782	435993.68	PROPOSED PERMANENT SUBSTATION ACCESS FOR HORNSEA PROJECT 4	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S15-OOX-02. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00211	2	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00623
30/01/2023	SECTION 15	OOX	S15-OOX-02	503588.705	435946.5246	PROPOSED CREYKE BECK SOLAR FARM	SURFACE	P	P	P	N	NONE TO DATE	METHODOLOGY FOR CROSSING OF PROPOSED SOLAR FARM TBC, REQUIREMENT FOR CROSSING TBC.	ID-00211	2	Y	N/A		ID-00624
30/01/2023	SECTION 15	EOX	S15-EOX-06	503660.307	435903.7934	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S15-WX-07	ID-00211	2	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00625
30/01/2023	SECTION 15	WX	S15-WX-07	503663.05	435903.7	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S15-OOX-02	ID-00211	2	Y		HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00626

DOGGER BANK SOUTH OFFSHORE WIND FARM OBSTACLE CROSSING REGISTER																			
30/01/2023	SECTION 15	PRX	S15-PRX-04	503749.937	435835.2841	PRIVATE ROAD - PARK LANE - ACCESS TO POPLAR FARM. ALSO PROW	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S15-OOX-02. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00212	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00627
30/01/2023	SECTION 15	EOX	S15-EOX-07	503733.445	435787.4468	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S15-PRX-04	ID-00212	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00628
30/01/2023	SECTION 15	EOX	S15-EOX-08	503756.231	435831.3397	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S15-PRX-04	ID-00213	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00629
30/01/2023	SECTION 15	WX	S15-WX-08	503760.62	435828.75	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE TRENCHING ASSUMED. POTENTIALLY CROSSED WITH S15-PRX-04	ID-00213	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00630
30/01/2023	SECTION 15	PRX	S15-PRX-05	503577.803	436136.4755	PROPOSED PERMANENT SUBSTATION ACCESS FOR HORNSEA PROJECT 4	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S15-WX-09. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00214	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00631
30/01/2023	SECTION 15	WX	S15-WX-09	503604.16	436132.378	WATERCOURSE / DRAIN	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S15-PRX-05	ID-00214	1	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00632
30/01/2023	SECTION 15	EOX	S15-EOX-09	503606.432	436131.8012	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S15-WX-09 AND S15-PRX-05	ID-00214	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00633
30/01/2023	SECTION 15	EOX	S15-EOX-10	503736.924	436031.6521	HEDGEROW	SURFACE	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED.	ID-00215	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00634
30/01/2023	SECTION 15	UUX	S15-UUX-04	503726.578	435952.2066	SABIC / INEOS HIGH PRESSURE ETHYLENE PIPELINE	BURIED	P	Y	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY REQUIRED	ID-00216	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00635
30/01/2023	SECTION 15	EOX	S15-EOX-11	503817.59	435937.08	HEDGEROW / TREES	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S15-PRX-06	ID-00217	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00636
30/01/2023	SECTION 15	PRX	S15-PRX-06	503821.734	435936.2426	PRIVATE ROAD - PARK LANE - ACCESS TO POPLAR FARM. ALSO PROW	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00217	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00637
30/01/2023	SECTION 15	EOX	S15-EOX-12	503827.917	435934.2483	HEDGEROW / TREES	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S15-PRX-06	ID-00217	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00638
30/01/2023	SECTION 15	PAT	S15-PAT-05	503836.093	435931.1238	TRACK - ACCESS FOR DOGGER BANK A&B CABLE ROUTE	SURFACE	Y	P	P	P	NONE TO DATE	CROSSED WITH S15-PRX-06	ID-00217	1	Y	N/A		ID-00639
30/01/2023	SECTION 15	WX	S15-WX-10	503969.81	435803.56	WATERCOURSE / DRAIN	SURFACE	P	Y	P	P	NONE TO DATE	CROSSED WITH S15-UUX-06	ID-00218	2	Y	CULVERT	HAUL ROAD CROSSING OF WATERCOURSE REQUIRED. CULVERT LIKELY BUT SUITABILITY TBC.	ID-00640
30/01/2023	SECTION 15	UUX	S15-UUX-08	503963.929	435782.1441	SABIC / INEOS HIGH PRESSURE ETHYLENE PIPELINE	BURIED	P	Y	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY REQUIRED	ID-00218	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00641
30/01/2023	SECTION 15	EOX	S15-EOX-13	503913.258	435633.0347	HEDGEROW / TREES	SURFACE	Y	P	P	N	NONE TO DATE	CROSSED WITH S15-PRX-07	ID-00219	1	Y	N/A	HAUL ROAD CROSSING OF HEDGEROW REQUIRED. WOULD TARGET GAPS IN HEDGEROW FOR HAUL ROAD WHERE POSSIBLE.	ID-00642
30/01/2023	SECTION 15	PRX	S15-PRX-07	503909.02	435630.6415	PRIVATE ROAD - PARK LANE - ACCESS TO POPLAR FARM. ALSO PROW	SURFACE	Y	P	P	P	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED. TRENCH CROSSING WOULD REQUIRE ROAD CLOSURE AND DIVERSION REQUIRED TO MAINTAIN ACCESS.	ID-00219	1	Y	N/A	ALLOWANCE FOR HAUL ROAD CROSSING OF ROAD REQUIRED.	ID-00643
30/01/2023	SECTION 15	UUX	S15-UUX-08	503908.382	435628.8837	KCOM GROUP TELECOM DUCT	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S15-PRX-07	ID-00219	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00644
30/01/2023	SECTION 15	UUX	S15-UUX-10	503907.969	435628.0026	KCOM GROUP TELECOM DUCT	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S15-PRX-07	ID-00219	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00645
30/01/2023	SECTION 15	UUX	S15-UUX-11	503903.743	435623.0279	KCOM GROUP TELECOM DUCT	BURIED	Y	P	P	P	NONE TO DATE	CROSSED WITH S15-PRX-07	ID-00219	1	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00646
30/01/2023	SECTION 15	OUX	S15-OUX-11	503871.875	435602.4248	NATIONAL GRID ELECTRICITY TRANSMISSION LINE - 400kV	OVERHEAD	Y	P	P	N	NONE TO DATE	ALL OPTIONS AVAILABLE, TRENCHING ASSUMED. MAY BE CROSSED WITH S15-PRX-07	ID-00220	1	Y	N/A	WORKS AND CROSSING BENEATH OVERHEAD ASSETS TO BE UNDERTAKEN IN ACCORDANCE WITH RELEVANT GUIDANCE. CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM SAFE WORKING AND CROSSING HEIGHTS.	ID-00647
30/01/2023	SECTION 15	UUX	S15-UUX-05	503945.35	435479.1096	NORTHERN GAS NETWORKS HIGH PRESSURE GAS MAIN	BURIED	P	P	P	N	NONE TO DATE	CROSSING MAY BE AVOIDED DEPENDING ON REFINED CABLE ROUTE AND FINAL CONNECTION LOCATION. ALL OPTIONS AVAILABLE, TRENCHLESS CROSSING LIKELY TO BE REQUIRED	ID-00221	2	Y	N/A	PROTECTION OF ASSET MAY BE REQUIRED FOR HAUL ROAD CROSSING, CONSULTATION WITH ASSET OWNER REQUIRED TO CONFIRM	ID-00648